



Environmental Protection Department

Contract No. HY/2012/06

**Widening of Fanling Highway
– Tai Hang to Wo Hop Shek
Interchange**

**Monthly EM&A Report
For April 2017**

[5/2017]

	Name	Signature
Prepared & Checked:	Sammi Lam	
Reviewed & Approved:	Y W Fung	

Version:	Rev. 0	Date: 11 May 2017
Disclaimer		
<p>This report is prepared for Environmental Protection Department and is given for its sole benefit in relation to and pursuant to Contract No. HY/2012/06 and may not be disclosed to, quoted to or relied upon by any person other than Environmental Protection Department without our prior written consent. No person (other than Environmental Protection Department) into whose possession a copy of this report comes may rely on this report without our express written consent and Environmental Protection Department may not rely on it for any purpose other than as described above.</p>		

<p>AECOM Asia Co. Ltd. 15/F, Grand Central Plaza, Tower 1, 138 Shatin Rural Committee Road, Shatin, NT, Hong Kong Tel: (852) 3922 9000 Fax: (852) 2317 7609 www.aecom.com</p>

Hyder-Arup-Black & Veatch Joint Venture
c/o Arcadis
20/F, AXA Tower, Landmark East,
100 How Ming Street,
Kwun Tong, Hong Kong
Attn: Mr. James Penny

Your Reference

Our Reference
JFP/EC/ST/p/T329380/22
.05/L-0167

20/F AIA Kowloon Tower
Landmark East
100 How Ming Street
Kwun Tong
Kowloon
Hong Kong

T +852 2828 5757
F +852 2827 1823
mottmac.hk

Environmental Monitoring and Audit (EM&A) for Widening of Tolo Highway/Fanling Highway between Island House Interchange and Fanling Stage 2 (between Tai Hang to Wo Hop Shek Interchange)
Environmental Permit No. EP-324/2008/E Condition 3.3 – Submission of Monthly EM&A Report – April 2017 for the portion of Stage 2 works under Contract No. HY/2012/06

11 May 2017
By Fax (2805 5028) & Hand

We refer to the revised Monthly EM&A Report – April 2017 received on 11 May 2017 submitted by the Environmental Team via email. Pursuant to Environmental Permit Condition 3.3, I hereby verify the Monthly EM&A Report – April 2017 (Rev. 0) for the portion of works under Stage 2 of the captioned Project which is managed under Contract No. HY/2012/06.

Yours faithfully
for MOTT MACDONALD HONG KONG LIMITED



Steven Tang
Independent Environmental Checker

c.c.
HyD
AECOM

Mr. Chung Lok Chin
Mr. Y W Fung

By Fax (2714 5198)
By Fax (2891 0305)

TABLE OF CONTENTS

	Page
EXECUTIVE SUMMARY	3
1 INTRODUCTION	5
1.1 Background	5
1.2 Scope of Report	6
1.3 Project Organization	6
1.4 Summary of Construction Works	7
1.5 Summary of EM&A Programme Requirements	7
2 AIR QUALITY MONITORING	8
2.1 Monitoring Requirements	8
2.2 Monitoring Equipment	8
2.3 Monitoring Locations	8
2.4 Monitoring Parameters and Frequency	8
2.5 Monitoring Methodology	9
2.6 Monitoring Schedule for the Reporting period	10
2.7 Results and Observations	11
3 NOISE MONITORING	12
3.1 Monitoring Requirements	12
3.2 Monitoring Equipment	12
3.3 Monitoring Locations	12
3.4 Monitoring Parameters and Frequency	12
3.5 Monitoring Methodology	13
3.6 Monitoring Schedule for the Reporting period	13
3.7 Monitoring Results	13
4 ENVIRONMENTAL SITE INSPECTION AND AUDIT	15
4.1 Site Inspection	15
4.2 Advice on the Solid and Liquid Waste Management Status	17
4.3 Environmental Licenses and Permits	18
4.4 Implementation Status of Environmental Mitigation Measures	20
4.5 Summary of Exceedances of the Environmental Quality Performance Limit	20
4.6 Summary of Complaints, Notification of Summons and Successful Prosecutions	20
5 FUTURE KEY ISSUES	21
5.1 Construction Programme for the Coming Months	21
5.2 Key Issues for the Coming Month	21
5.3 Monitoring Schedule for the Coming Month	21
6 CONCLUSIONS AND RECOMMENDATIONS	22
6.1 Conclusions	22
6.2 Recommendations	22

List of Tables

Table 1.1	Contact Information of Key Personnel
Table 2.1	Air Quality Monitoring Equipment
Table 2.2	Locations of Impact Air Quality Monitoring Station
Table 2.3	Air Quality Monitoring Parameters and Frequency
Table 2.4	Summary of 1-hour TSP Monitoring Results in the Reporting Period
Table 2.5	Summary of 24-hour TSP Monitoring Results in the Reporting Period
Table 3.1	Noise Monitoring Equipment
Table 3.2	Locations of Impact Noise Monitoring Stations
Table 3.3	Noise Monitoring Parameters, Frequency and Duration
Table 3.4	Summary of Construction Noise Monitoring Results in the Reporting Period
Table 4.1	Summary of Waste Flow Table for Contract No. HY/2012/06
Table 4.2	Summary of Waste Flow Table for Contract No. 02/HY/2015 (Works Order Nos. CB128520-5 and CB128519-0)
Table 4.3	Summary of Environmental Licensing and Permit Status

Figures

Figure 1.1	General Project Layout Plan of Contract No. HY/2012/06
Figure 1.2	General Project Layout Plan of Contract No. 02/HY/2015 (Works Order Nos. CB128520-5 and CB128519-0)
Figure 1.3a-b	Locations of Monitoring Station
Figure 4.1	Environmental Complaint Handling Procedures

List of Appendices

Appendix A	Project Organization Structure
Appendix B	Construction Programme
Appendix C	Implementation Schedule of Environmental Mitigation Measures (EMIS)
Appendix D	Summary of Action and Limit Levels
Appendix E	Calibration Certificates of Monitoring Equipments
Appendix F	EM&A Monitoring Schedules
Appendix G	Impact Air Quality Monitoring Results and their Graphical Presentation
Appendix H	Meteorological Data for the Reporting period
Appendix I	Impact Daytime Construction Noise Monitoring Results and their Graphical Presentation
Appendix J	Event Action Plan
Appendix K	Site Inspection Summaries
Appendix L	Statistics on Complaints, Notifications of Summons and Successful Prosecutions

EXECUTIVE SUMMARY

The proposed widening of Tolo Highway and Fanling Highway between Island House Interchange and Fanling (the Project) is a Designated Project under the Environmental Impact Assessment Ordinance (Cap. 499) (EIAO). An Environmental Impact Assessment (EIA) Report (the approved EIA Report) together with an Environmental Monitoring and Audit (EM&A) Manual (the approved EM&A Manual) were completed and approved under the EIAO on 14 July 2000 (Register Number: EIA-043/2000).

The objective of the Project “Widening of Tolo Highway / Fanling Highway between Island House Interchange and Fanling” is to widen Tolo Highway and Fanling Highway to dual 4-lane carriageway in order to alleviate the current traffic congestion problems and to cope with the increasing transport demands to and from the urban areas and also cross boundary traffic.

The Project is a designated project and governed by an Environmental Permit (EP-324/2008) issued by the EPD on 23 December 2008. Subsequently, the EPD issued Variation of Environmental Permits of EP-324/2008/A, EP-324/2008/B, EP-324/2008/C and EP-324/2008/D on 31 January 2012, 17 March 2014, 27 March 2015 and 27 August 2015 respectively. The current valid VEP was applied on 29 December 2016 and the VEP (EP-324/2008/E) was subsequently granted on 26 January 2017.

The construction works for this Project are delivered in 2 stages i.e. Stage 1 (between Island House Interchange and Tai Hang) and Stage 2 (between Tai Hang and Wo Hop Shek Interchange). Stage 2 would be implemented under three works contracts. Contract No. HY/2012/06 “Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange” and the entrusted portion to CEDD under Contract No. CV/2012/09 “Liantang/Heung Yuen Wai Boundary Control Point Site Formation and Infrastructure Works – Contract 3”. In addition, Contract No. “Provision of Bus-Bus Interchange on Fanling Highway Kowloon Bound” was carried out within the site boundary of Contract No. 02/HY/2015. This report focuses on Contract No. HY/2012/06 “Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange” in Stage 2 of the Project and “Provision of Bus-Bus Interchange on Fanling Highway Kowloon Bound” under Works Order Nos. CB128520-5 and CB128519-0 in Contract No. 02/HY/2015 “Highway Department Term Contract (Management and Maintenance of Roads in Tai Po and North District excluding High Speed Roads 2016-2022)”.

Pursuant to the EP (EP-324/2008/E) Condition 2.7, the Capture Survey Trip Report for Ma Wat River Northern Meander (Version 2) for the Project was submitted on 24 December 2013 by the Environmental Team (ET) and verified by the Independent Environmental Checker (IEC) on 6 January 2014.

The construction phase of the Contract under the EP and the Environmental Monitoring and Audit (EM&A) programme of the contract commenced on 21 November 2013. The impact environmental monitoring and audit includes air quality and noise monitoring.

This report documents the findings of EM&A works conducted in the period between 1 and 30 April 2017. As informed by the Contractor, construction activities of Contract No. HY/2012/06 in the reporting period were:

- Site clearance
- Ground investigation
- Pipe laying
- Retaining wall construction
- Noise Barrier
- Excavation
- Backfilling
- Drainage
- House Construction
- Foot Bridge demolition
- Bridge construction
- Piling

As informed by the Contractor, construction activities of Works Order Nos. CB128520-5 and CB128519-0 under Contract No. 02/HY/2015 in the reporting period were:

- Installation of sheet-piles
- Construction of footing
- Installation of safety beams

Reporting Change

There was no reporting change required in the reporting period.

Breaches of Action and Limit Levels for Air Quality

No exceedance of Action and Limit Level was recorded for 1-hour and 24-hour TSP monitoring in the reporting period.

Breaches of Action and Limit Levels for Noise

No Action or Limit Level exceedance of construction noise was recorded in the reporting month. No noise complaints related to 0700 – 1900 hours on normal weekdays was received and followed by Environmental Team in the reporting month.

Complaint, Notification of Summons and Successful Prosecution

No complaint, notification of summons and successful prosecution was received in the reporting period.

Future Key Issues

Key issues to be considered in the coming month include:

- Properly store and label oils and chemicals on site;
- Chemical, chemical waste and waste management;
- Collection of construction waste should be carried out regularly;
- Properly maintain all drainage facilities and wheel washing facilities on site;
- Exposed slopes should be covered up properly if no temporary work will be conducted;
- Quieter powered mechanical equipment should be used;
- Suppress dust generated from excavation activities and haul road traffic; and
- Tree protective measures for all retained trees should be well maintained.

1 INTRODUCTION

1.1 Background

- 1.1.1. Tolo Highway and Fanling Highway are the expressways in the North East New Territories (NENT) connecting Sha Tin, Tai Po and Fanling. These highways form a vital part of the strategic Route 9, which links Hong Kong Island to the boundary at Shenzhen. At present, this section of Route 9 is a dual 3-lane carriageway. However, at several major interchanges along this section of Route 9, the highway is a dual-2 lane carriageway only. Severe congestion is a frequent occurrence during the peak periods, particularly in the Kowloon-bound direction.
- 1.1.2. The objective of the Project “Widening of Tolo Highway / Fanling Highway between Island House Interchange and Fanling” is to widen Tolo Highway and Fanling Highway to dual 4-lane carriageway in order to alleviate the current traffic congestion problems and to cope with the increasing transport demands to and from the urban areas and also cross boundary traffic.
- 1.1.3. The Project is a designated project and governed by an Environmental Permit (EP-324/2008) issued by the EPD on 23 December 2008. Subsequently, the EPD issued Variation of Environmental Permits of EP-324/2008/A, EP-324/2008/B, EP-324/2008/C and EP-324/2008/D on 31 January 2012, 17 March 2014, 27 March 2015 and 27 August 2015 respectively. The current valid VEP was applied on 29 December 2016 and the VEP (EP-324/2008/E) was subsequently granted on 26 January 2017.
- 1.1.4. The scope of the Project comprises mainly:-
- (i) Widening of a 5.7 km section of Tolo Highway and 3.0 km section of Fanling Highway between Island House Interchange and Wo Hop Shek Interchange from the existing dual 3-lane to dual 4-lane, including construction of new vehicular bridges;
 - (ii) Widening of interchange sections at Island House Interchange, Tai Po North Interchange, and Lam Kam Road Interchange from dual 2-lane to dual 3-lane, except Sha Tin bound carriageway at Tai Po North Interchange, which is widened from 3-lane to 4-lane, including realignment of various slip roads;
 - (iii) Modification and reconstruction of highways, vehicular bridges, underpasses and footbridges.
- 1.1.5. The construction works for this Project will be delivered in 2 stages i.e. Stage 1 (between Island House Interchange and Tai Hang) and Stage 2 (between Tai Hang and Wo Hop Shek Interchange). Stage 2 would be implemented under two works contracts. Contract No. HY/2012/06 “Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange” and the entrusted portion to CEDD under Contract No. CV/2012/09 “Liantang/Heung Yuen Wai Boundary Control Point Site Formation and Infrastructure Works – Contract 3”. In addition, Contract No. “Provision of Bus-Bus Interchange on Fanling Highway Kowloon Bound” was carried out within the site boundary of Contract No. 02/HY/2015. This report focuses on Contract No. HY/2012/06 “Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange” in Stage 2 of the Project and “Provision of Bus-Bus Interchange on Fanling Highway Kowloon Bound” under Works Order Nos. CB128520-5 and CB128519-0 in Contract No. 02/HY/2015 “Highway Department Term Contract (Management and Maintenance of Roads in Tai Po and North District excluding High Speed Roads 2016-2022)”.
- 1.1.6. Hyder-Arup-Black and Veatch Joint Venture (HABVJV) are appointed by Highways Department (HyD) as the consultants for the design and construction assignment for the Tolo project under Agreement No. CE 58/2000 Supplementary Agreement No. 3 (SA3) (i.e. the Engineer for Contract No. HY/2012/06).
- 1.1.7. China State Construction Engineering (Hong Kong) Ltd. (CSHK) was commissioned as the Contractor of Contract No. HY/2012/06. Chiu Hing Construction & Transportation Company Limited (Chiu Hing) was commissioned as the Contractor of Contract No. 02/HY/2015.
- 1.1.8. AECOM Asia Co. Ltd. was commissioned by China State Construction Engineering (Hong Kong) Limited as the Environmental Team (ET) to undertake the Environmental Monitoring and Audit

(EM&A) works for the Contract and Mott MacDonald Hong Kong Ltd. acts as the Independent Environmental Checker (IEC) for the Contract.

1.1.9. The construction phase of the Contract under the EP commenced on 21 November 2013.

1.1.10. According to the updated EM&A Manual of Stage 2 of the Project, there is a need of an EM&A programme including air quality and noise monitoring. The EM&A programme for Stage 2 of the Project commenced on 21 November 2013.

1.2 Scope of Report

1.2.1 This is the forty-second monthly EM&A Report under the Contract No. HY/2012/06 “Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange. This report presents a summary of the environmental monitoring and audit works, list of activities and mitigation measures proposed by the ET for the Contract in April 2017.

1.3 Project Organization

1.3.1 The project organization structure is shown in Appendix A. The key personnel contact names and numbers are summarized in Table 1.1.

Table 1.1 Contact Information of Key Personnel

Party	Position	Name	Telephone	Fax
ER (Hyder-Arup-Black & Veatch Joint Venture)	Chief Resident Engineer	Edwin Chung	6115 0818	2638 0950
IEC (Mott MacDonald Hong Kong Limited)	Independent Environmental Checker	Steven Tang	2828 5920	2827 1823
Contractor of [HY/2012/06] (China State Construction Engineering (Hong Kong) Limited)	Environmental Officer	Michael Tsang	9277 4956	2672 2501
		C C Chow	9679 6315	2672 2501
Contractor of [02/HY/2015] (Chiu Hing Construction & Transportation Company Limited)	Safety Officer	Marty Tai	9106 5318	-
ET (AECOM Asia Company Limited)	ET Leader	Y W Fung	3922 9393	3922 9797

1.4 Summary of Construction Works

1.4.1 The construction phase for the Contract under the EP commenced on 21 November 2013.

1.4.2 Details of the construction works of Contract No. HY/2012/06 carried out by the Contractor in this reporting period are listed below:

- Site clearance
- Ground investigation
- Pipe laying
- Retaining wall construction
- Noise Barrier
- Excavation
- Backfilling
- Drainage
- House Construction
- Foot Bridge demolition
- Bridge construction
- Piling

Details of the construction works of Works Order Nos. CB128520-5 and CB128519-0 under Contract No. 02/HY/2015 carried out by the Contractor in this reporting period are listed below:

- Installation of sheet-piles
- Construction of footing
- Installation of safety beams

1.4.3 The Construction Programme is shown in Appendix B.

1.4.4 The general layout plan of the Project site of Contract No. HY/2012/06 and Works Order Nos. CB128520-5 and CB128519-0 under 02/HY/2015 showing the contract areas are shown in Figure 1.1 and Figure 1.2 respectively.

1.4.5 The environmental mitigation measures implementation schedule are presented in Appendix C.

1.5 Summary of EM&A Programme Requirements

1.5.1 The EM&A programme required environmental monitoring for air quality, noise and environmental site inspections for air quality, water quality, noise, waste management, ecology, and landscape and visual impact. The EM&A requirements for each parameter described in the following sections include:-

- All monitoring parameters;
- Monitoring schedules for the reporting period and forthcoming months;
- Action and Limit levels for all environmental parameters;
- Event / Action Plan;
- Environmental mitigation measures, as recommended in the Project EIA study final report; and
- Environmental requirement in contract documents.

2 AIR QUALITY MONITORING

2.1 Monitoring Requirements

2.1.1 In accordance with the updated EM&A Manual, baseline 1-hour and 24-hour TSP levels at one air quality monitoring station was established. Impact 1-hour TSP monitoring was conducted for at least three times every 6 days, while impact 24-hour TSP monitoring was carried out for at least once every 6 days. The Action and Limit level of the air quality monitoring is provided in Appendix D.

2.2 Monitoring Equipment

2.2.1 24-hour TSP air quality monitoring was performed using High Volume Sampler (HVS) located at each designated monitoring station. The HVS meets all the requirements of the updated EM&A Manual. Portable direct reading dust meters were used to carry out the 1-hour TSP monitoring. Brand and model of the equipment is given in Table 2.1.

Table 2.1 Air Quality Monitoring Equipment

Equipment	Brand and Model
Portable direct reading dust meter (1-hour TSP)	Sibata Digital Dust Monitor (Model No. LD-3)
High Volume Sampler (24-hour TSP)	Tisch Total Suspended Particulate Mass Flow Controlled High Volume Air Sampler (Model No. TE-5170)

2.3 Monitoring Locations

2.3.1 The monitoring station was set up at the proposed location in accordance with updated EM&A Manual. Table 2.2 describes details of the monitoring station. The locations are shown in Figure 1.3a.

Table 2.2 Locations of Impact Air Quality Monitoring Station

Location	Monitoring Station
AM2 (SR2)	Fanling Government Secondary School

2.4 Monitoring Parameters and Frequency

2.4.1 Table 2.3 summarizes the monitoring parameters, frequency and duration of impact TSP monitoring.

Table 2.3 Air Quality Monitoring Parameters and Frequency

Parameter	Frequency
24-hour TSP	Once every 6 days
1-hour TSP	3 times every 6 days while the highest dust impact was expected

2.5 Monitoring Methodology

2.5.1 24-hour TSP Monitoring

- (a) The HVS was installed in the vicinity of the air sensitive receivers. The following criteria were considered in the installation of the HVS.
- (i) A horizontal platform with appropriate support to secure the sampler against gusty wind was provided.
 - (ii) The distance between the HVS and any obstacles, such as buildings, was at least twice the height that the obstacle protrudes above the HVS.
 - (iii) A minimum of 2 meters separation from walls, parapets and penthouse for rooftop sampler.
 - (iv) A minimum of 2 meters separation from any supporting structure, measured horizontally.
 - (v) No furnace or incinerator flues nearby.
 - (vi) Airflow around the sampler was unrestricted.
 - (vii) Permission was obtained to set up the samplers and access to the monitoring stations.
 - (viii) A secured supply of electricity was obtained to operate the samplers.
 - (ix) The sampler was located more than 20 meters from any dripline.
 - (x) Any wire fence and gate, required to protect the sampler, did not obstruct the monitoring process.
 - (xi) Flow control accuracy was kept within $\pm 2.5\%$ deviation over 24-hour sampling period.
- (b) Preparation of Filter Papers
- (i) Glass fibre filters, G810 were labelled and sufficient filters that were clean and without pinholes were selected.
 - (ii) All filters were equilibrated in the conditioning environment for 24 hours before weighing. The conditioning environment temperature was around 25 °C and not variable by more than ± 3 °C; the relative humidity (RH) was < 50% and not variable by more than $\pm 5\%$. A convenient working RH was 40%.
 - (iii) All filter papers were prepared and analysed by ALS Technichem (HK) Pty Ltd., which is a HOKLAS accredited laboratory and has comprehensive quality assurance and quality control programmes.
- (c) Field Monitoring
- (i) The power supply was checked to ensure the HVS works properly.
 - (ii) The filter holder and the area surrounding the filter were cleaned.
 - (iii) The filter holder was removed by loosening the four bolts and a new filter, with stamped number upward, on a supporting screen was aligned carefully.
 - (iv) The filter was properly aligned on the screen so that the gasket formed an airtight seal on the outer edges of the filter.
 - (v) The swing bolts were fastened to hold the filter holder down to the frame. The pressure applied was sufficient to avoid air leakage at the edges.
 - (vi) Then the shelter lid was closed and was secured with the aluminum strip.
 - (vii) The HVS was warmed-up for about 5 minutes to establish run-temperature conditions.
 - (viii) A new flow rate record sheet was set into the flow recorder.
 - (ix) On site temperature and atmospheric pressure readings were taken and the flow rate of the HVS was checked and adjusted at around 1.1 m³/min, and complied with the range specified in the updated EM&A Manual (i.e. 0.6-1.7 m³/min).
 - (x) The programmable digital timer was set for a sampling period of 24 hrs, and the starting time, weather condition and the filter number were recorded.
 - (xi) The initial elapsed time was recorded.
 - (xii) At the end of sampling, on site temperature and atmospheric pressure readings were taken and the final flow rate of the HVS was checked and recorded.
 - (xiii) The final elapsed time was recorded.

- (xiv) The sampled filter was removed carefully and folded in half length so that only surfaces with collected particulate matter were in contact.
- (xv) It was then placed in a clean plastic envelope and sealed.
- (xvi) All monitoring information was recorded on a standard data sheet.
- (xvii) Filters were then sent to ALS Technichem (HK) Pty Ltd. for analysis.

(d) Maintenance and Calibration

- (i) The HVS and its accessories were maintained in good working condition, such as replacing motor brushes routinely and checking electrical wiring to ensure a continuous power supply.
- (ii) 5-point calibration of the HVS was conducted using TE-5025A Calibration Kit prior to the commencement of baseline monitoring. Bi-monthly 5-point calibration of the HVS will be carried out during impact monitoring.
- (iii) Calibration certificate of the HVSs are provided in Appendix E.

2.5.2 1-hour TSP Monitoring

(a) Measuring Procedures

The measuring procedures of the 1-hour dust meter were in accordance with the Manufacturer's Instruction Manual as follows:-

- (i) Turn the power on.
- (ii) Close the air collecting opening cover.
- (iii) Push the "TIME SETTING" switch to [BG].
- (iv) Push "START/STOP" switch to perform background measurement for 6 seconds.
- (v) Turn the knob at SENSI ADJ position to insert the light scattering plate.
- (vi) Leave the equipment for 1 minute upon "SPAN CHECK" is indicated in the display.
- (vii) Push "START/STOP" switch to perform automatic sensitivity adjustment. This measurement takes 1 minute.
- (viii) Pull out the knob and return it to MEASURE position.
- (ix) Push the "TIME SETTING" switch the time set in the display to 3 hours.
- (x) Lower down the air collection opening cover.
- (xi) Push "START/STOP" switch to start measurement.

(b) Maintenance and Calibration

- (i) The 1-hour TSP meter was calibrated at 1-year intervals against a continuous particulate TEOM Monitor, Series 1400ab. Calibration certificates of the Laser Dust Monitors are provided in Appendix E.
- (ii) 1-hour validation checking of the TSP meter against HVS is carried out yearly at the air quality monitoring locations.

2.6 Monitoring Schedule for the Reporting period

2.6.1 The schedule for environmental monitoring in April 2017 is provided in Appendix F.

2.7 Results and Observations

2.7.1 The monitoring results for 1-hour TSP and 24-hour TSP are summarized in Table 2.4 and 2.5 respectively. Detailed impact air quality monitoring results are presented in Appendix G.

Table 2.4 Summary of 1-hour TSP Monitoring Results in the Reporting Period

Location	Average ($\mu\text{g}/\text{m}^3$)	Range ($\mu\text{g}/\text{m}^3$)	Action Level ($\mu\text{g}/\text{m}^3$)	Limit Level ($\mu\text{g}/\text{m}^3$)
AM2 (Fanling Government Secondary School)	71.4	66.7 – 76.6	317.8	500

Table 2.5 Summary of 24-hour TSP Monitoring Results in the Reporting Period

Location	Average ($\mu\text{g}/\text{m}^3$)	Range ($\mu\text{g}/\text{m}^3$)	Action Level ($\mu\text{g}/\text{m}^3$)	Limit Level ($\mu\text{g}/\text{m}^3$)
AM2 (Fanling Government Secondary School)	46.2	27.0 – 69.6	200.7	260

2.7.2 The major dust source during the monitoring was mainly from nearby traffic emission.

2.7.3 All 1-hour and 24-hour TSP results were below the Action and Limit Level at all monitoring locations in the reporting period.

2.7.4 The event action plan is annexed in Appendix J.

2.7.5 Weather information including wind speed and wind direction is annexed in Appendix H. The information was obtained from the Hong Kong Observatory Tai Po and Tai Mei Tuk Automatic Weather Stations.

3 NOISE MONITORING

3.1 Monitoring Requirements

3.1.1 In accordance with the EM&A Manual, impact noise monitoring was conducted for at least once per week during the construction phase of the Contract. The Action and Limit level of the noise monitoring is provided in Appendix D.

3.2 Monitoring Equipment

3.2.1 Noise monitoring was performed using sound level meter at each designated monitoring station. The sound level meters deployed comply with the International Electrotechnical Commission Publications (IEC) 651:1979 (Type 1) and 804:1985 (Type 1) specifications. Acoustic calibrator was deployed to check the sound level meters at a known sound pressure level. Brand and model of the equipment is given in Table 3.1.

Table 3.1 Noise Monitoring Equipment

Equipment	Brand and Model
Integrated Sound Level Meter	B&K 2238
Acoustic Calibrator	Rion NC-73

3.3 Monitoring Locations

3.3.1 Monitoring stations M2 and M3 were set up at the proposed locations in accordance with updated EM&A Manual. Figure 1.3a-b shows the locations of the monitoring stations. Table 3.2 describes the details of the monitoring stations.

Table 3.2 Locations of Impact Noise Monitoring Stations

Monitoring Station	Location	Description
M2	West Tai Wo	1.2m from the ground floor free-field of the Residential
M3	Fanling Government Secondary School	1m from the exterior of the roof top façade of the school

3.4 Monitoring Parameters and Frequency

3.4.1 Table 3.3 summarizes the monitoring parameters, frequency and duration of impact noise monitoring.

Table 3.3 Noise Monitoring Parameters, Frequency and Duration

Parameter	Frequency
30-mins measurement at each monitoring station between 0700 and 1900 on normal weekdays. L_{eq} , L_{10} and L_{90} would be recorded.	At least once per week

3.5 Monitoring Methodology

3.5.1 Monitoring Procedure

- (a) Façade measurement was made at monitoring station M3, while free-field measurement was made at monitoring station M2.
- (b) The sound level meter was set on a tripod at a height of 1.2 m above the ground for free-field measurements at monitoring station M2.
- (c) The battery condition was checked to ensure the correct functioning of the meter.
- (d) Parameters such as frequency weighting, the time weighting and the measurement time were set as follows:-
 - (i) frequency weighting: A
 - (ii) time weighting: Fast
 - (iii) time measurement: $L_{eq(30\text{-minutes})}$ during non-restricted hours i.e. 07:00 – 1900 on normal weekdays; $L_{eq(5\text{-minutes})}$ during restricted hours i.e. 19:00 – 23:00 and 23:00 – 07:00 of normal weekdays, whole day of Sundays and Public Holidays
- (e) Prior to and after each noise measurement, the meter was calibrated using the acoustic calibrator for 94dB(A) at 1000 Hz. If the difference in the calibration level before and after measurement was more than 1 dB(A), the measurement would be considered invalid and repeat of noise measurement would be required after re-calibration or repair of the equipment.
- (f) During the monitoring period, the L_{eq} , L_{10} and L_{90} were recorded. In addition, site conditions and noise sources were recorded on a standard record sheet.
- (g) Noise measurement was paused during periods of high intrusive noise (e.g. dog barking, helicopter noise) if possible. Observations were recorded when intrusive noise was unavoidable.
- (h) Noise monitoring was cancelled in the presence of fog, rain, wind with a steady speed exceeding 5m/s, or wind with gusts exceeding 10m/s.

3.5.2 Maintenance and Calibration

- (a) The microphone head of the sound level meter was cleaned with soft cloth at regular intervals.
- (b) The meter and calibrator were sent to the supplier or HOKLAS laboratory to check and calibrate at yearly intervals.
- (c) Calibration certificates of the sound level meters and acoustic calibrators are provided in Appendix E.

3.6 Monitoring Schedule for the Reporting period

3.6.1 The schedule for environmental monitoring in April 2017 is provided in Appendix F.

3.7 Monitoring Results

3.7.1 The monitoring results for construction noise are summarized in Table 3.4 and the monitoring data is provided in Appendix I.

Table 3.4 Summary of Construction Noise Monitoring Results in the Reporting Period

Location	Average, dB(A), L_{eq} (30 mins)	Range, dB(A), L_{eq} (30 mins)	Limit Level, dB(A), L_{eq} (30 mins)
M2* (West Tai Wo)	69.3	67.0 – 70.9	75
M3# (Fanling Government Secondary School)	64.1	60.0 – 67.4	65/70

*+3dB(A) Façade correction included

Limit Level of 70dB(A) applies to education institutes while 65dB(A) applies during school examination period.

- 3.7.2 No Action or Limit Level exceedance of construction noise was recorded in the reporting month. No noise complaints related to 0700 – 1900 hours on normal weekdays was received and followed by Environmental Team in the reporting month.
- 3.7.3 Major noise sources during noise monitoring in the reporting period were mainly road traffic noise.
- 3.7.4 The event action plan is annexed in Appendix J.

4 ENVIRONMENTAL SITE INSPECTION AND AUDIT

4.1 Site Inspection

4.1.1 Site Inspections were carried out on a weekly basis to monitor the implementation of proper environmental pollution control and mitigation measures for the Contract. In the reporting period, 4 site inspections were carried out respectively on 5, 13, 18 and 25 April 2017 for the Contract. While no specific observation was recorded, recommendations on remedial actions were given to the Contractor for precautionary purpose.

4.1.2 The environmental site inspections summaries are provided in Appendix K.

4.1.3 Particular observations during the site inspections are described below:

Contract No. HY/2012/06

Air Quality

4.1.4 Exposed stockpiles were found at SA328. The Contractor should cover exposed stockpiles with impervious sheeting to prevent windblown dust emission.

4.1.5 Mud trail was observed at SA328. The Contractor should provide wheel washing facilities at the vehicle exit point and clean up the mud trail for dust suppression.

4.1.6 Non-Road Mobile Machinery (NRMM) without proper label was found at SA326. The Contractor should ensure valid labels are provided for all NRMM before operations.

4.1.7 Exposed slope without cover was observed at SA310. The Contractor should cover the exposed slope properly to avoid potential windblown dust emission.

4.1.8 Public access road at SA323 was observed dusty. The Contractor should provide sufficient measures to keep the public access road clear of dusty material.

Noise

4.1.9 No adverse observation was identified in the reporting period.

Water Quality

4.1.10 No adverse observation was identified in the reporting period.

Chemical and Waste Management

4.1.11 Excessive accumulation of construction wastes was observed at SA328. The Contractor should remove the wastes and maintain the site clean and tidy.

4.1.12 Chemical containers without secondary containments were found at NB75 and SA328. The Contractor was advised to provide them with a drip trays to prevent potential leakage.

4.1.13 Motor oil was found accumulated in the drip tray of welder generator at NB75. The Contractor was advised to dispose of the oil as chemical waste and ensure the equipment is well-maintained.

4.1.14 Construction wastes were found scattered on ground at SA324. The Contractor should remove the construction wastes and maintain the site clean and tidy.

Landscape and Visual Impact

4.1.15 No adverse observation was identified in the reporting period.

Miscellaneous

4.1.16 Stagnant water was observed at Nam Wah Po Bridge and SA328. The Contractor should remove the stagnant water or apply larvicidal oil to prevent mosquito breeding.

4.1.17 Retained water was observed in the drip tray of generator at NB75. The Contractor was advised to remove the water to prevent overflow of chemical in case of spillage.

Contract No. 02/HY/2015 (Works Order Nos. CB128520-5 and CB128519-0)

Air Quality

4.1.18 No adverse observation was identified in the reporting period.

Noise

4.1.19 No adverse observation was identified in the reporting period.

Water Quality

4.1.20 No adverse observation was identified in the reporting period.

Chemical and Waste Management

4.1.21 No adverse observation was identified in the reporting period.

Landscape and Visual Impact

4.1.22 No adverse observation was identified in the reporting period.

Miscellaneous

4.1.23 Stagnant water was observed on the ground. The Contractor was advised to remove the water to prevent mosquito breeding.

4.2 Advice on the Solid and Liquid Waste Management Status

- 4.2.1 Contract No. HY/2012/06 has registered as chemical waste producers for the Contract. C&D material sorting was carried out on site. Sufficient numbers of receptacles were available for general refuse collection.
- 4.2.2 As advised by the Contractor of Contract No. HY/2012/06, 2,046 m³ of inert C&D material was generated in the reporting month (469 m³ disposed of as public fill to Tuen Mun 38, 842 m³ of inert C&D materials was reused on site, 735 m³ of inert C&D materials was reused in other projects and 0m³ was broken concrete). For C&D wastes, 60 m³ of general refuse was disposed of at NENT landfill, 82 kg of paper/cardboard packaging, 0 kg of plastics and 0 kg of metals were collected by recycling Contractors, and 0 kg of chemical wastes was collected by licensed Contractors in the reporting period.
- 4.2.3 The actual amounts of different types of waste generated by the activities of the Project in the reporting period are shown in Table 4.1.

Table 4.1 Summary of Waste Flow Table for Contract No. HY/2012/06

Waste Type	Actual Amount	Disposal/Reuse Locations
Inert C&D materials disposed as public fill	469 m ³	Tuen Mun 38
Broken concrete	0 m ³	Tuen Mun 38
C&D wastes disposed as general refuse	60 m ³	NENT Landfill
Paper/cardboard packaging	82 kg	Recycling Facilities
Plastics	0 kg	Recycling Facilities
Metals	0 kg	Recycling Facilities
C&D materials reused on site	842 m ³	Site Area
C&D materials reused in other projects	735 m ³	Other projects
Chemical wastes	0 kg	Licensed Contractors

- 4.2.4 As advised by the Contractor of Works Order Nos. CB128520-5 and CB128519-0 under Contract No. 02/HY/2015, 4 m³ of inert C&D material was generated in the reporting month (3 m³ disposed of as public fill to Tuen Mun 38, 0 m³ of inert C&D materials was reused on site, 0 m³ of inert C&D materials was reused in other projects and 1 m³ was broken concrete). For C&D wastes, 0 m³ of general refuse was disposed of at NENT landfill, 1 kg of paper/cardboard packaging, 1 kg of plastics and 0 kg of metals were collected by recycling Contractors in the reporting period.
- 4.2.5 The actual amounts of different types of waste generated by the activities of the Project in the reporting period are shown in Table 4.2.

Table 4.2 Summary of Waste Flow Table for Contract No. 02/HY/2015 (Works Order Nos. CB128520-5 and CB128519-0)

Waste Type	Actual Amount	Disposal/Reuse Locations
Inert C&D materials disposed as public fill	3 m ³	Tuen Mun 38
Broken concrete	1 m ³	Tuen Mun 38
C&D wastes disposed as general refuse	0 m ³	NENT Landfill
Paper/cardboard packaging	1 kg	Recycling Facilities
Plastics	1 kg	Recycling Facilities

Waste Type	Actual Amount	Disposal/Reuse Locations
Metals	0 kg	Recycling Facilities
C&D materials reused on site	0 m ³	Site Area
C&D materials reused in other projects	0 m ³	Other projects

4.2.6 The Contractors were advised to maintain on-site waste sorting and recording system and maximize reuse / recycle of C&D wastes.

4.3 Environmental Licenses and Permits

4.3.1 The environmental licenses and permits for Stage 2 of the Project and valid in the reporting period is summarized in Table 4.3.

Table 4.3 Summary of Environmental Licensing and Permit Status

Statutory Reference	License/ Permit	License or Permit No.	Valid Period		License / Permit Holder	Remarks
			From	To		
EIAO	Environmental Permit	EP-324/2008/E	26/01/2017	N/A	HyD	
WPCO	Discharge License (Site)	WT00017159-2013 *	18/09/2013	30/09/2018	CSHK	--
WDO	Chemical Waste Producer Registration	5213-722-C3822-01	05/09/2013	N/A	CSHK	Chemical waste produced in Contract HY/2012/06
WDO	Billing Account for Disposal of Construction Waste	7017860	N/A	N/A	CSHK	Waste disposal in Contract HY/2012/06
		7024392	N/A	N/A	Chiu Hing	Waste disposal in Contract 02/HY/2015
APCO	Notification Under Air Pollution Control (Construction Dust) Regulation	361991	15/07/2013	N/A	Chiu Hing	--
		414360	08/03/2017	N/A	Chiu Hing	--
NCO	Construction Noise Permit	GW-RN0777-16	26/10/2016	02/04/2017	CSHK	Zone 2 Dismantling of steel platform of Kau Lung Hang Vehicular Bridge
		GW-RN0914-16	20/12/2016	31/05/2017	CSHK	Zone 2 Demolition of NWPFB near Ho Ka Yuen
		GW-RN0938-16	15/12/2016	14/06/2017	CSHK	Zone 4 Grouting for Piling Works near Wo Hop

Statutory Reference	License/ Permit	License or Permit No.	Valid Period		License / Permit Holder	Remarks
			From	To		
						Shek Village
		GW-RN0088-17	09/02/2017	27/05/2017	CSHK	Zone 2B Demolition of WHSB over TWSRW
		GW-RN0109-17	28/02/2017	31/05/2017	CSHK	Zone 4 Dismantling of High Mast at Slip Road from Jockey Club Road to SB of Fanling Highway
		GW-RN0151-17	14/03/2017	18/05/2017	CSHK	Zone 4 Road Marking Alternation at NB of Fanling Highway between CH23.8 and CH24.1
		GW-RN0170-17	17/03/2017	16/06/2017	CSHK	Zone 4 Tree Felling and Loading of Streetlight Pole at Southbound of Fanling Highway between CH24.1 and CH24.2
		GW-RN0150-17	16/03/2017	27/04/2017	CSHK	Zone 2 Road resurfacing at northbound of Fanling Highway near Nam Wah Po between CH22.3 and CH22.5
		GW-RN0207-17	30/03/2017	27/05/2017	CSHK	Zone 2 Demolition of Steel Platform P6 of KLHVB
		GW- RN0229-17	07/04/2017	15/06/2017	CSHK	Zone 4 Road Marking Alternation Southbound of Fanling Highway near Ho Ka Yuen

Statutory Reference	License/ Permit	License or Permit No.	Valid Period		License / Permit Holder	Remarks
			From	To		
		GW-RN0254-17	20/04/2017	28/07/2017	CSHK	Zone 2 Erection of metal scaffold Tai Wo Service Road West near NWP

* Treated wastewater produced from Contract No. 02/HY/2015 is discharged to the discharge point currently listed in the discharge license granted by the Contract No. HY/2012/06.

4.4 Implementation Status of Environmental Mitigation Measures

4.4.1 A summary of the Implementation Schedule of Environmental Mitigation Measures (EMIS) is presented in Appendix C.

4.5 Summary of Exceedances of the Environmental Quality Performance Limit

4.5.1 All 1-hour and 24-hour TSP monitoring results complied with the Action / Limit Levels in the reporting period.

4.5.2 No Action or Limit Level exceedance of construction noise was recorded in the reporting month. No noise complaints related to 0700 – 1900 hours on normal weekdays was received and followed by Environmental Team in the reporting month.

4.6 Summary of Complaints, Notification of Summons and Successful Prosecutions

4.6.1 The Environmental Complaint Handling Procedure is annexed in Figure 4.1.

4.6.2 No complaint, notification of summons and successful prosecution was received in the reporting period.

4.6.3 Statistics on complaints, notifications of summons and successful prosecutions are summarized in Appendix L.

5 FUTURE KEY ISSUES

5.1 Construction Programme for the Coming Months

5.1.1 The major construction works for Contract No. HY/2012/06 in May 2017 will be:-

- Site clearance
- Ground investigation
- Pipe laying
- Retaining wall construction
- Noise Barrier
- Excavation
- Backfilling
- Drainage
- House Construction
- Foot Bridge demolition
- Bridge construction
- Piling

5.1.2 The major construction works for Works Order Nos. CB128520-5 and CB128519-0 under Contract No. 02/HY/2015 in May 2017 will be:-

- Noise barriers footings and associate stem walls construction

5.2 Key Issues for the Coming Month

5.2.1 Key issues to be considered in May 2017:-

- Properly store and label oils and chemicals on site;
- Chemical, chemical waste and waste management;
- Collection of construction waste should be carried out regularly;
- Properly maintain all drainage facilities and wheel washing facilities on site;
- Exposed slopes should be covered up properly if no temporary work will be conducted;
- Quieter powered mechanical equipment should be used;
- Suppress dust generated from excavation activities and haul road traffic; and
- Tree protective measures for all retained trees should be well maintained.

5.3 Monitoring Schedule for the Coming Month

5.3.1 The tentative schedule for environmental monitoring in May 2017 is provided in Appendix F.

6 CONCLUSIONS AND RECOMMENDATIONS

6.1 Conclusions

- 6.1.1 The construction phase and EM&A programme of the Contract commenced on 21 November 2013.
- 6.1.2 All 1-hour and 24-hour TSP monitoring results complied with the Action / Limit Levels in the reporting period.
- 6.1.3 No Action or Limit Level exceedance of construction noise was recorded in the reporting month. No noise complaints related to 0700 – 1900 hours on normal weekdays was received and followed by Environmental Team in the reporting month.
- 6.1.4 4 environmental site inspections were carried out in April 2017. Recommendations on remedial actions were given to the Contractors for the deficiencies identified during the site audits.
- 6.1.5 No complaint, notification of summons and successful prosecution was received in the reporting period.

6.2 Recommendations

- 6.2.1 According to the environmental site inspections performed in the reporting period, the following recommendations on remedial actions were provided to the Contractor for precautionary purpose:

Contract No. HY/2012/06

Air Quality Impact

- The Contractor should cover exposed stockpiles with impervious sheeting to prevent windblown dust emission.
- The Contractor should provide wheel washing facilities at the vehicle exit point and clean up the mud trail for dust suppression.
- The Contractor should ensure valid labels are provided for all NRMM before operations.
- The Contractor should cover the exposed slope properly to avoid potential windblown dust emission.
- The Contractor should provide sufficient measures to keep the public access road clear of dusty material.

Noise Impact

- No adverse observation was identified in the reporting period.

Water Quality Impact

- No adverse observation was identified in the reporting period.

Chemical and Waste Management

- The Contractor should remove the excessive construction wastes and maintain the site clean and tidy.
- The Contractor was advised to provide chemical containers with drip trays to prevent potential leakage.
- The Contractor was advised to dispose of the oil in the drip tray as chemical waste and ensure the equipment is well-maintained.
- The Contractor should remove the construction wastes scattered on ground and maintain the site clean and tidy.
- The Contractor was advised to remove the water in the trip tray to prevent overflow of chemical in case of spillage.

Landscape and Visual Impact.

- No adverse observation was identified in the reporting period.

Miscellaneous

- The Contractor should remove the stagnant water or apply larvicidal oil to prevent mosquito breeding.

Contract No. 02/HY/2015 (Works Order Nos. CB128520-5 and CB128519-0)

Air Quality Impact

- No adverse observation was identified in the reporting period.

Noise Impact

- No adverse observation was identified in the reporting period.

Water Quality Impact

- No adverse observation was identified in the reporting period.

Chemical and Waste Management

- No adverse observation was identified in the reporting period.


Landscape and Visual Impact.

- No adverse observation was identified in the reporting period.

Miscellaneous

- The Contractor was advised to remove the water to prevent mosquito breeding.

FIGURES

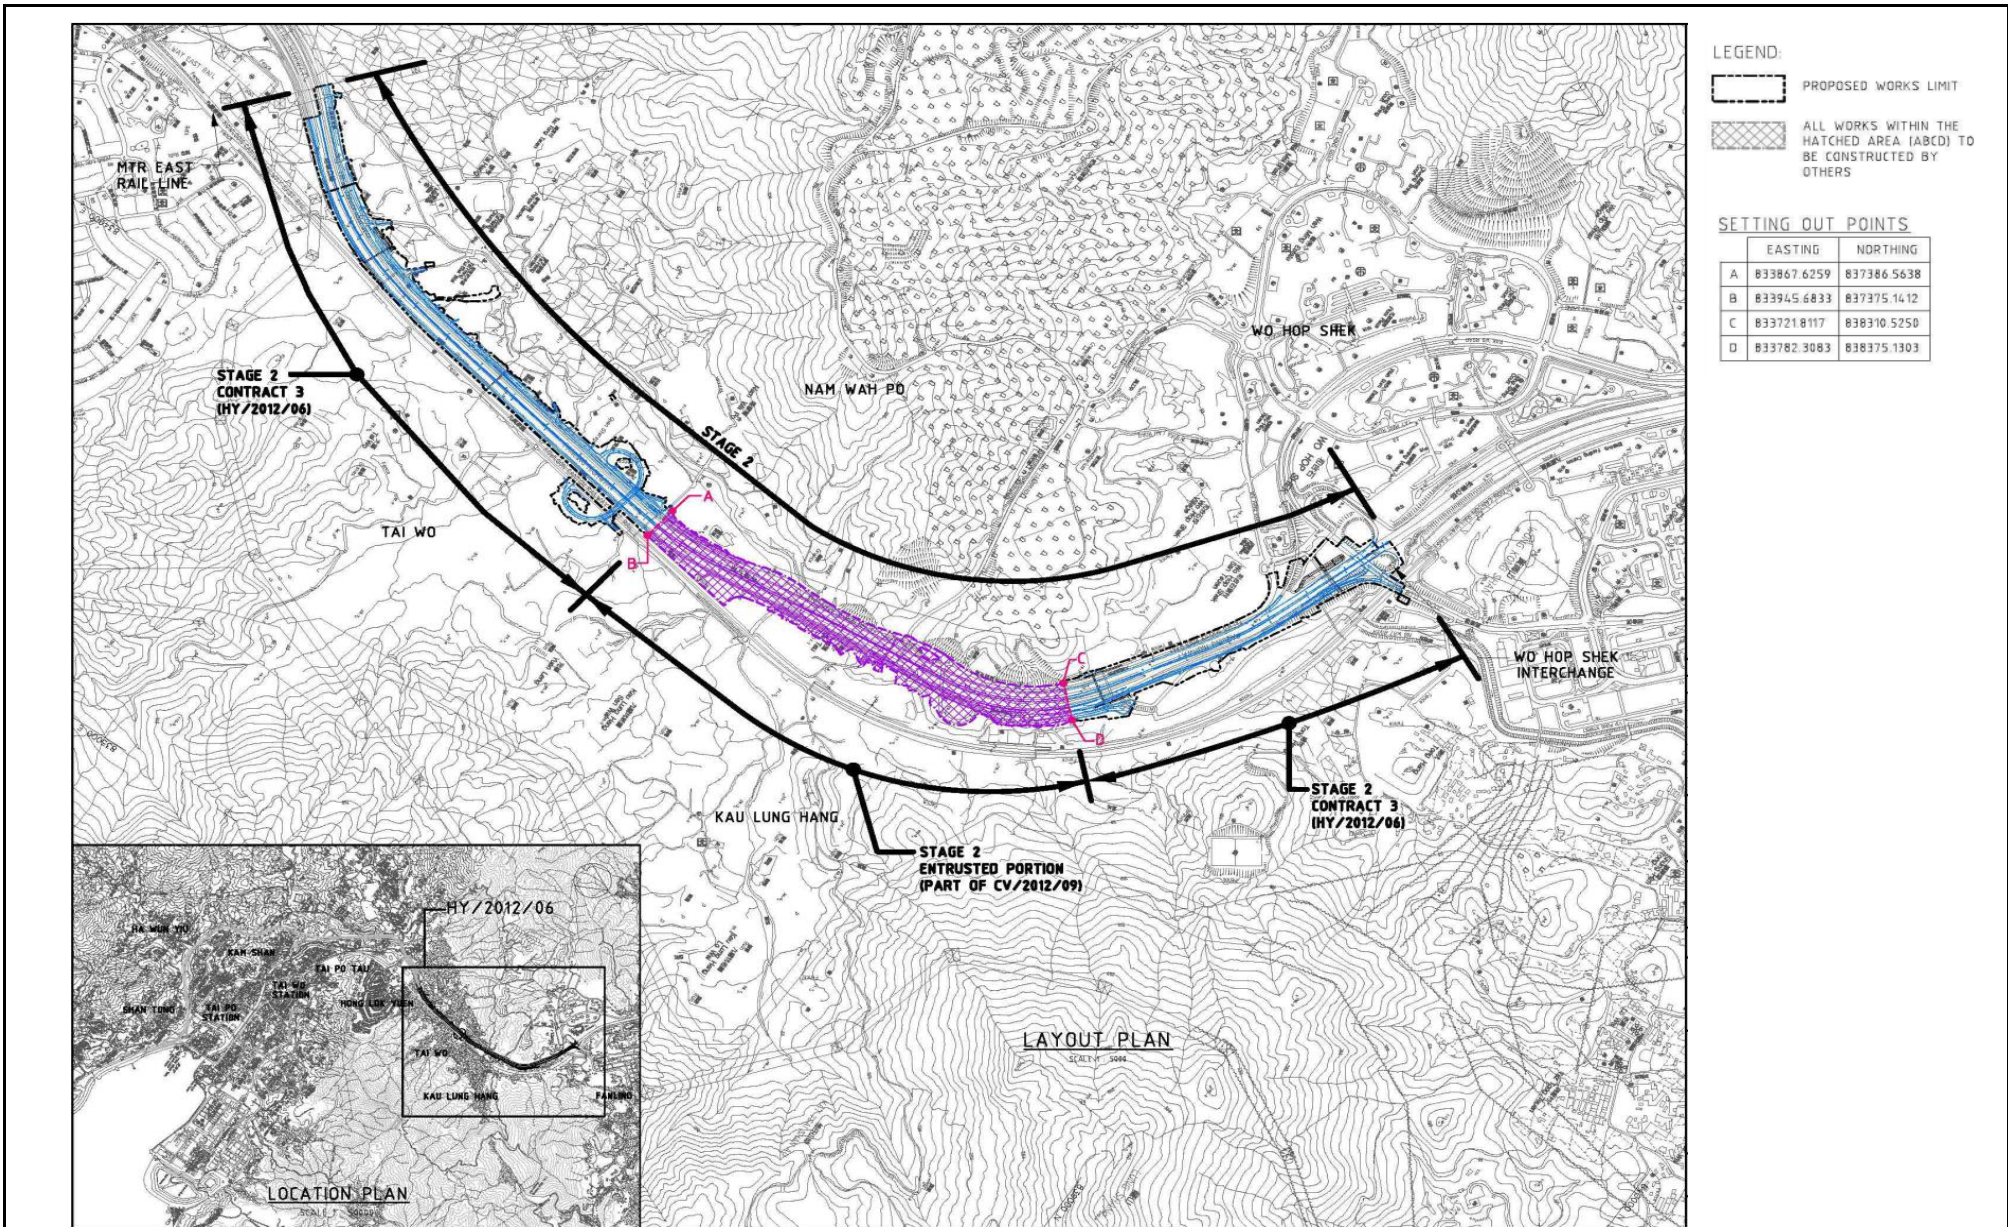

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.


CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Layout Plan

Date: Dec 2013

Figure 1.1

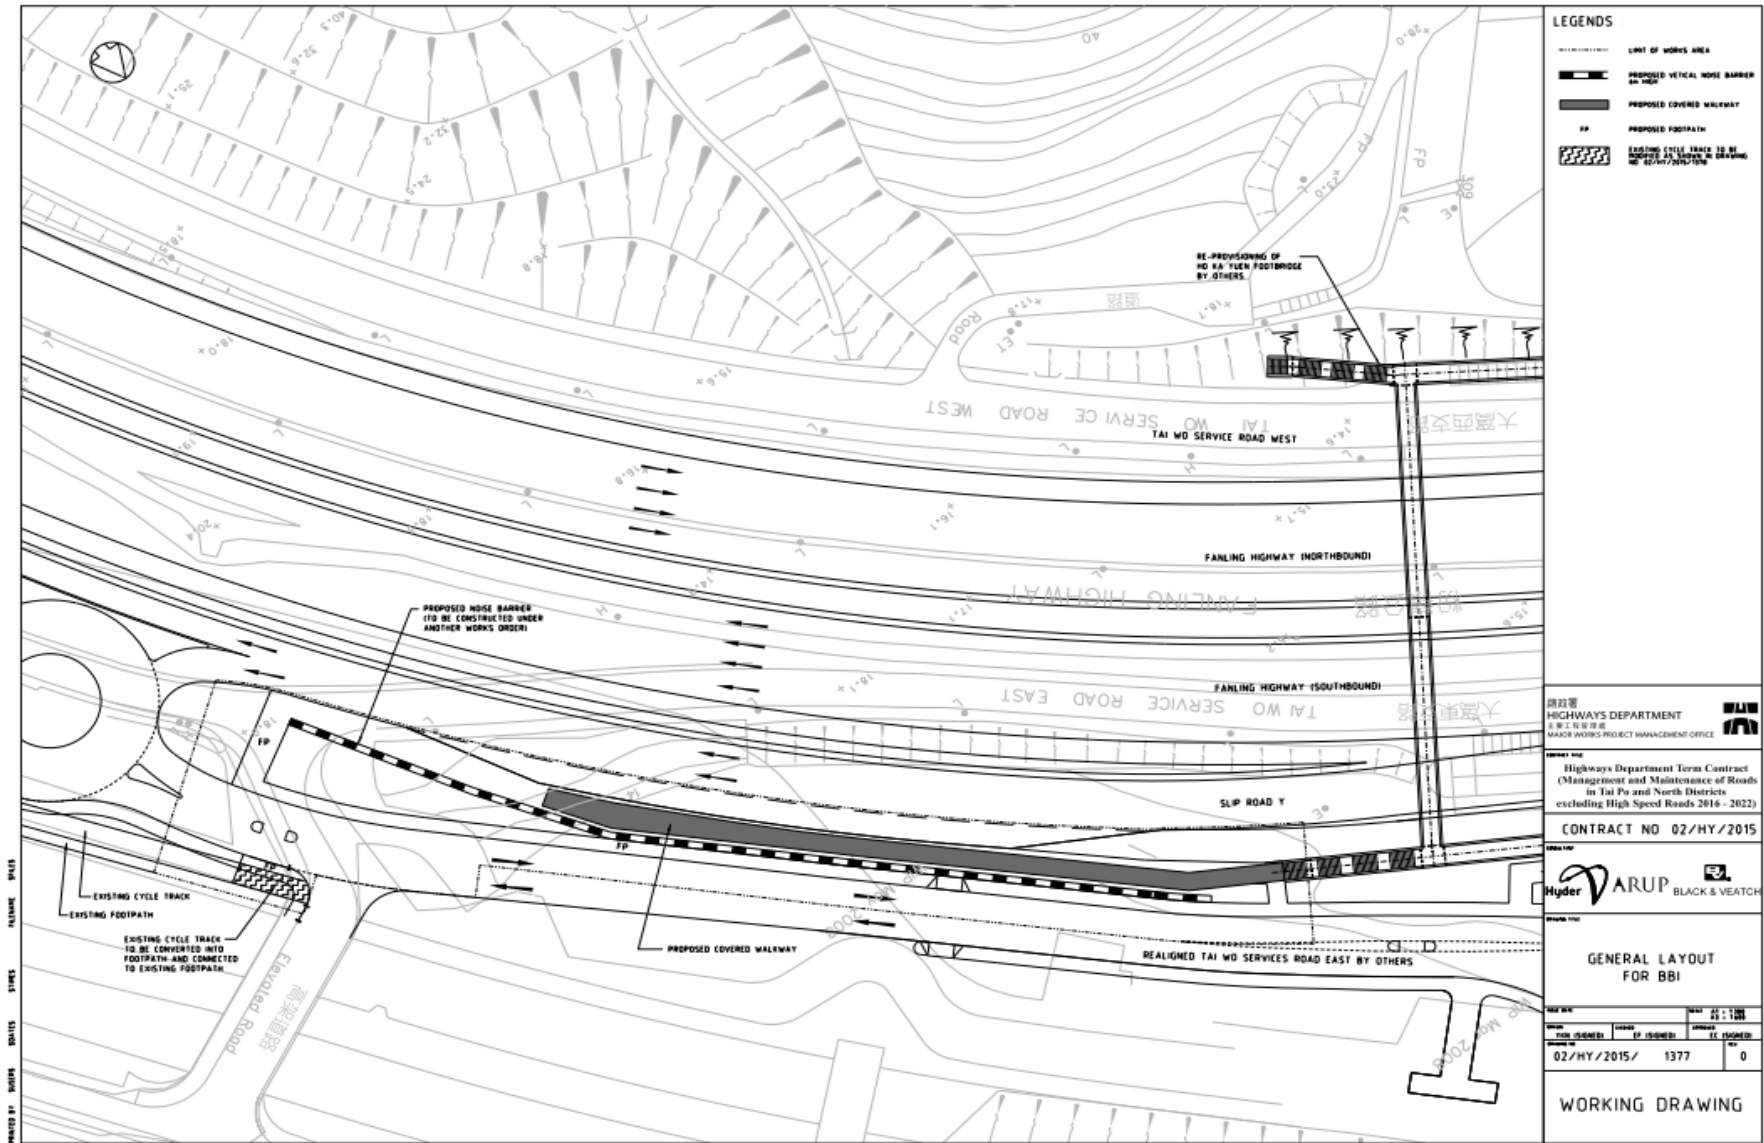

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.


CONTRACT NO. 02/HY/2015
 PROVISION OF BUS-BUS INTERCHANGE ON FANLING HIGHWAY KOWLOON BOUND



Layout Plan

Date: Apr 2017

Figure 1.2

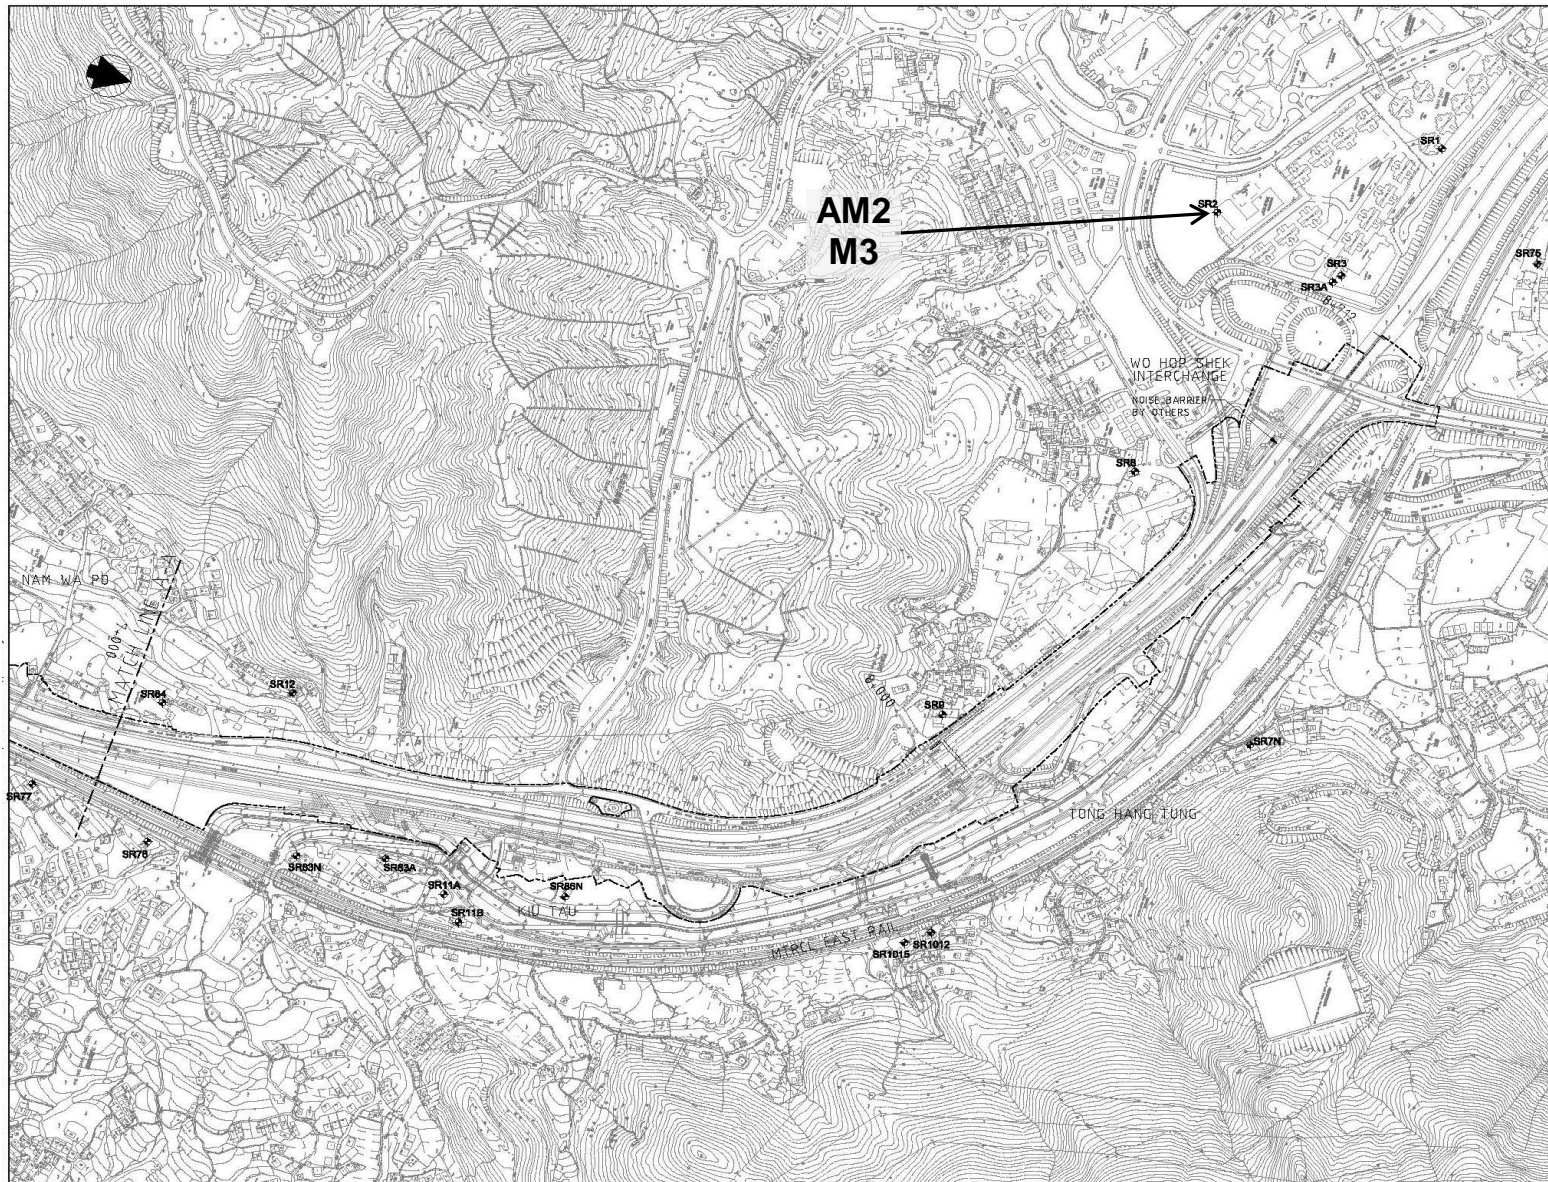

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.


CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Locations of Monitoring Station

Date: Dec 2013

Figure 1.3a

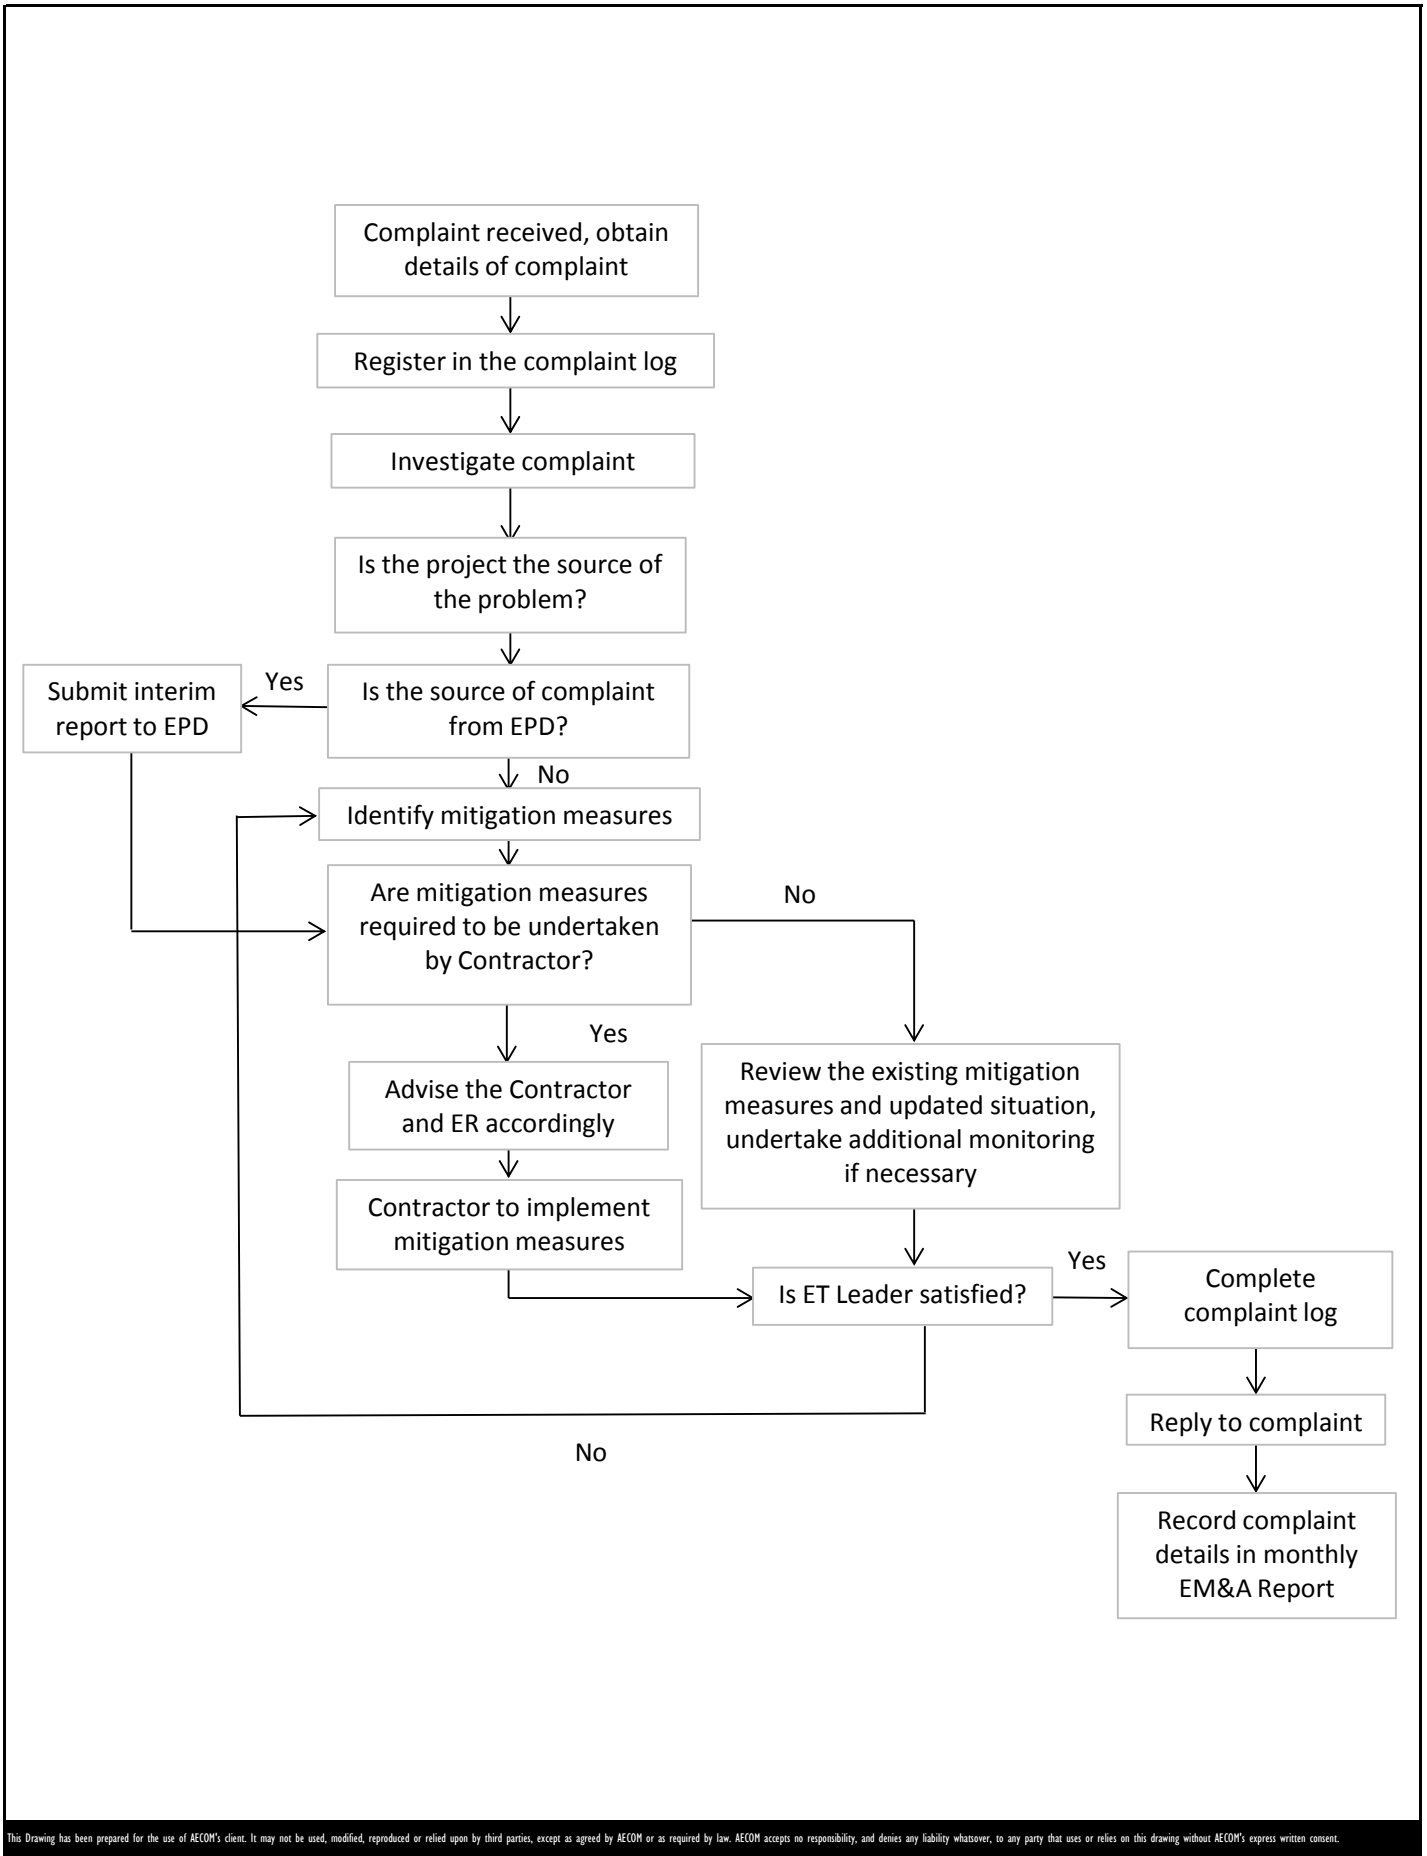


This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.

CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Environmental Complaint Handling Procedure

**APPENDIX A
PROJECT ORGANIZATION STRUCTURE**

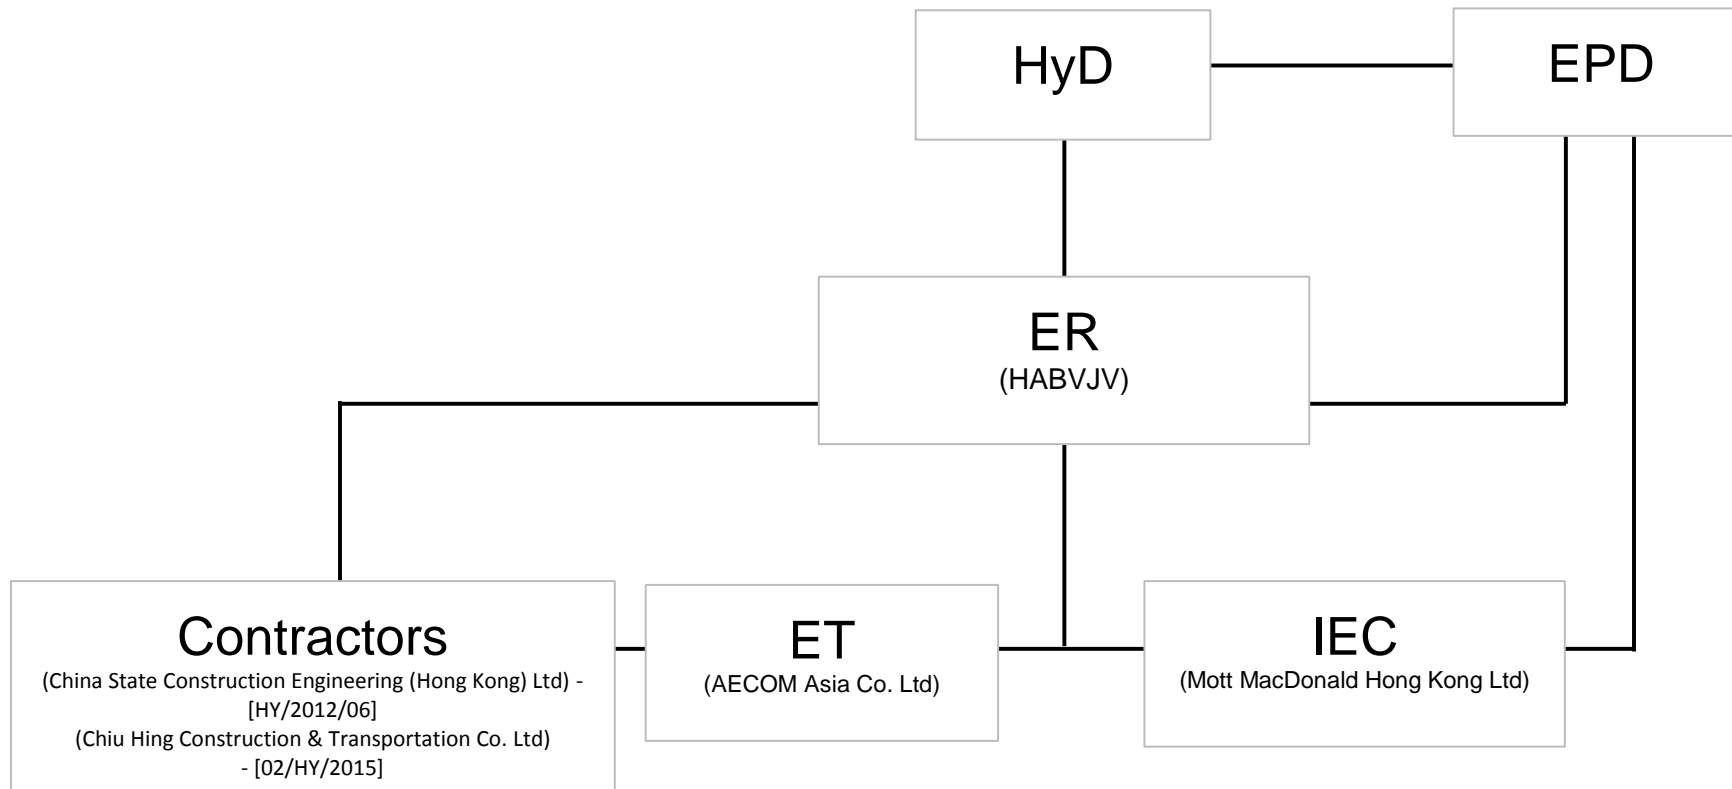

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.


CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Project Organization Structure

**APPENDIX B
CONSTRUCTION PROGRAMMES**

Activity ID	Activity Name	Dur. % Complete	Rem. Duration	Original Duration	Start	Finish	Total Float	2017				
								Apr	May	Jun	Jul	
Contract Condition												
General												
Contract Condition												
Contract Condition												
KD12	KD-12 (1239d) - S2:Achievement Demolition of Nam Wa Po	0%	0	0		29-Apr-17*	-74					29-Apr-17* ◆ KD-12 (1239d) - S2:Achievement Demolition of Nam Wa Po Footbridge
KD13	KD-13 (1309d) -S3: Connection of realigned Tai Wo Service Road	0%	0	0		13-Jul-17*	53					13-Jul-17* ◆ KD-
POSSA323A	Site Area SA323A (360d) (not required)	0%	0	0	20-Apr-17		1176					◆ Site Area SA323A (360d) (not required)
POSSA327	Site Area SA327 (180d)	0%	0	0	20-Apr-17*		-840					◆ Site Area SA327 (180d)
POSSA327A	Site Area SA327A (730d)	0%	0	0	20-Apr-17*		-642					◆ Site Area SA327A (730d)
POSSA345	Site Area SA345 (0d)	0%	0	0	20-Apr-17*		-507					◆ Site Area SA345 (0d)
ZONE 1 (Ch. 5640 to 5880)												
Noise Barrier Along Fanling Highway N/B												
Site Clearance & Demolition of Existing Structure												
Underground Utility Works												
ADVZ20180	Utility cable changeover period (NWT)	57.97%	87	207	21-Dec-16 A	15-Jul-17	184					
ADVZ20182	Additional Utility cable changeover period (PCCW, HCG)	58.17%	87	208	20-Dec-16 A	15-Jul-17	184					
TWSR-West Construction												
Drainage & Road Works												
Ch 5640-5880												
RDZ10090	Z1: New Tai Wo Service Road West - Drainage & Road works (2 lanes)	94.02%	11	184	15-Aug-16 A	04-May-17	103					
ZONE 2 (Ch. 5880 to 6930)												
General												
DRM Proposal												
DRM Proposal												
ADVZ20200	Utility cable changeover period (All Utility Companies)(9 months)	63.86%	103	285	20-Oct-16 A	31-Jul-17*	0					
ADVZ20220	New TWSR-W construction period	86.96%	24	184	15-Aug-16 A	19-May-17	156					
ADVZ20225	Divert Existing TWSR-W to New TWSR-W	0%	5	5	20-May-17	25-May-17	224					
ADVZ20230	Construct Temp Road at NB at North bound (0.5 HS+Lane 1 & 2)	8%	92	100	08-Apr-17 A	09-Aug-17	0					
Noise Barrier Along TWSR-West and Laying New Utilities												
NB48 (Ch.5995-6120)-TWSR West Side												
DSD Southern Trunk Sewer, Water Main Fire Main Works												
TSZ10440	Firemain installation (along NB48, 0-60m)	95.61%	9	205	20-Jun-16 A	29-Apr-17	156					
NB54 (Ch.6240-6280)-TWSR West Side												
Noise Barrier Works												
NB00720	NB54 - NB post & panel installation	0%	5	5	02-May-17*	08-May-17	0					
NB54A (Ch.6290-6350)-TWSR West Side												
Noise Barrier Works												
NB00790	NB54A - NB post & panel installation	0%	5	5	09-May-17	13-May-17	584					
DSD Southern Trunk Sewer, Water Main Fire Main Works												
TSZ10680	Watermain installation (along NB54A)	98.26%	5	288	14-Mar-16 A	25-Apr-17	951					
TSZ10690	Firemain installation (along NB54A)	87.69%	8	65	19-Dec-16 A	28-Apr-17	160					
NB59 (Ch.6490-6590)-TWSR West Side												
Noise Barrier Works												
NB01000	NB59 - NB post installation	89.19%	12	111	15-Oct-16 A	05-May-17	591					
Noise Barrier Along Fanling Highway N/B												
Site Clearance & Demolition of Existing Structure												
General												
ADVZ20160	TTA for NB works	0%	60	60	20-Apr-17	03-Jul-17	162					
NB60 (Ch.6450-6920)-FH N/B Side												
Noise Barrier Works												
NB01751	NB60 (0-15m)(NB60/1) Pre-drilling	0%	12	12	07-Jul-17	20-Jul-17	88					
Bridge Construction												
New Tai Hang Footbridge												
General												
THBF0370	Steel Staircase & Bridge prefabrication (THFB-TWSR-E side)	71.1%	50	173	20-Jul-16 A	20-Jun-17	252					
THBF0380	Steel Staircase & Bridge available on site (THFB-TWSR-E side)	0%	0	0	21-Jun-17		252					◆ Steel Staircase & Bridge
TWSR-West/ FL Highway N/B Side Section												
THBF0620	Finishes Work	0%	60	60	27-Feb-17 A	03-Jul-17	332					
THBF0625	Bridge Structure complete (THFB-TWSR-W side)	0%	0	0		03-Jul-17	332					03-Jul-17 ◆ Bridge Struct
Crossing Fanling Highway Section												
THBF0530	THP1 - Predrilling	0%	12	12	20-Apr-17	05-May-17	163					
THBF0540	THP1 - Pre-bored H pile (6 nos)	0%	45	45	06-May-17	28-Jun-17	163					
THBF0550	THP1 - Pile Test	0%	28	28	29-Jun-17	26-Jul-17	198					
THBF0560	THP1 - Pile cap, Pier and Pier Head	0%	100	100	13-Jul-17	09-Nov-17	164					
TWSR-East FL Highway S/B Side Section												
THBF0470	THAB1 - pile cap & abutment wall	62.39%	41	109	21-Nov-16 A	09-Jun-17	895					
THBF0480	THAB1 - Backfilling (~3m)	0%	20	20	10-Jun-17	04-Jul-17	895					
THBF0520	THP2 - Pile cap, Pier and Pier Head	0%	82	45	20-Mar-17 A	28-Jul-17	220					
THBF0780	Modified existing column head of existing footbridge	0%	30	30	20-Apr-17	26-May-17	242					
THBF0785	Reconstruction of existing span between P4 and existing pier	0%	30	30	27-May-17	03-Jul-17	242					



Project ID: WP Rev 04 (1704)
 Layout: 3 Month Rolling Program
 Page 1 of 5

Contract No. HY/2012/06
Widening of Fanling Highway - Tai Hang to Wo Hop Shek Interchange
3 Month Rolling Program(20-Apr-17)



Date	Revision	C...	A..
13-May-14	WP Rev 1		
30-Jun-14	WP Rev 1A		
28-Aug-15	WP Rev 2		
07-Apr-16	WP Rev 3		
08-Nov-16	WP Rev 4		

Activity ID	Activity Name	Dur. % Complete	Rem. Duration	Original Duration	Start	Finish	Total Float	2017				
								Apr	May	Jun	Jul	
Lift at TWSR-W Side												
L1520	Lift shaft & roof	87.72%	28	228	16-Jul-16 A	24-May-17	244					
L1530	Structural Laminated glass wall installation	0%	30	30	25-May-17	29-Jun-17	288					
L1540	RC Platform connect to bridge	0%	30	30	25-May-17	29-Jun-17	244					
L1550	Metal cover on RC platform	0%	30	30	30-Jun-17	04-Aug-17	244					
L1557	Lift submission & ordering period	89.96%	26	259	02-Jul-16 A	22-May-17	320					
L1600	CLP Power available (by CLP)	71.29%	122	425	21-Jun-16 A	19-Aug-17	388					
Lift at FLHY S/B												
L1370	Lift shaft & roof	78.57%	33	154	20-Sep-16 A	31-May-17	256					
L1380	Structural Laminated glass wall installation	0%	30	30	01-Jun-17	06-Jul-17	286					
L1390	RC Platform connect to bridge (THSC-2 & TH-P2)	0%	30	30	01-Jun-17	06-Jul-17	256					
L1400	Roof cover for RC Platform	0%	30	30	07-Jul-17	10-Aug-17	256					
L1450	CLP Power available (by CLP)	64%	153	425	21-Jun-16 A	19-Sep-17	360					
New Tai Wo Footbridge												
General												
TWFB1090	Steel Bridge prefabrication (TWFB)	80.11%	37	186	15-Aug-16 A	05-Jun-17	416					
TWFB1100	Steel Bridge available on site (TWFB)	0%	0	0	06-Jun-17		416					◆ Steel Bridge available on site (TWFB)
TWSR-West/ FL Highway N/B Side Section												
TWFB1370	Erect Staircase (TWFB-TWSR-W side)	88.57%	8	70	07-Dec-16 A	28-Apr-17	551					
TWFB1390	Finishes Work	0%	30	30	29-Apr-17	06-Jun-17	551					
TWFB1400	Bridge Structure complete (TWFB-TWSR-W side)	0%	0	0		06-Jun-17	551					◆ Bridge Structure complete (TWFB-TW)
Crossing Fanling Highway Section												
TWFB1420	TWP2 - Pre-bored H pile (6 nos)	0%	30	30	01-Jun-17*	06-Jul-17	0					
TWFB1430	TWP2 - Pile Test	0%	28	28	07-Jul-17	03-Aug-17	31					
Lift at TWSR-W Side												
L1670	Lift shaft & roof	84.78%	35	230	21-Jun-16 A	02-Jun-17	374					
L1680	Structural Laminated glass wall installation	0%	30	30	03-Jun-17	08-Jul-17	417					
L1690	RC Link slab connect to bridge	0%	30	30	03-Jun-17	08-Jul-17	374					
L1700	Metal cover on RC platform	0%	30	30	10-Jul-17	12-Aug-17	374					
L1730	Lift submission & ordering period	79.25%	61	294	02-Jul-16 A	04-Jul-17	421					
L1780	CLP Power available (by CLP)	61.52%	152	395	20-Aug-16 A	18-Sep-17	526					
Temporary Tai Wo Footbridge												
Construction Works												
TWFB-T1208	Erect Temp Column & link bridge to existing bridge at FLHY S/B	0%	90	90	13-Jul-17	27-Oct-17	125					
TWSR-West Construction												
Drainage & Road Works												
Ch 5880-6740												
RDZ20160	Z2 : New TWSR-West D&R Works (lane 1)	85.83%	17	120	01-Nov-16 A	19-May-17	156					
Noise Barrier Along Fanling Highway S/B												
NB46A (Ch.5880-5935)-FH S/B Side												
Noise Barrier Works												
NB03240	Excavation & DN600 pipe laying	13.33%	65	75	08-Mar-17 A	08-Jul-17	388					
NB03300	DN600 water connection by WSD	0%	14	14	10-Jul-17	25-Jul-17	388					
NB51 (Ch.5935-6055)-FH S/B Side												
Noise Barrier Works												
NB02280	NB51 ID1-3 (0-25m) - Footing & Wall Structure	0%	90	90	20-Feb-17 A	07-Aug-17	458					
NB02330	NB51(25-118m) - Footing & Wall Structure	6.67%	84	90	13-Mar-17 A	31-Jul-17	333					
NB52 (Ch.6055-6125) -FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB02370	NB52 - Sheet piling & Excavation	75.93%	26	108	04-Nov-16 A	22-May-17	522					
NB02380	NB52 - Footing & Wall Structure	58.33%	50	120	18-Nov-16 A	20-Jun-17	498					
NB02390	NB52- backfilling	0%	50	50	21-Jun-17	18-Aug-17	498					
NB02400	NB52 - NB production	0%	45	45	21-Jun-17	04-Aug-17	629					
NB53 (Ch.6125-6300) -FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB02430	Precautionary Measure installation	0%	26	26	20-Apr-17	22-May-17	404					
NB02440	NB53 (0-100m) - Sheet piling & Excavation	0%	26	26	23-May-17	22-Jun-17	451					
NB02450	NB53 (0-100m) - Footing & Wall Structure	0%	60	60	23-Jun-17	01-Sep-17	451					
NB02490	NB53 ID2-3 (100-125m), 18nos Predrilling	0%	10	10	06-Jun-17	16-Jun-17	393					
NB02500	NB53 ID2-3 (100-125m) 18nos Piling- 1 rigs	0%	27	27	17-Jun-17	19-Jul-17	393					
NB02590	NB53 (125-180m) - NB production	95.17%	14	290	20-May-16 A	03-May-17	722					
NB02600	NB53 (125-180m) - NB post & panel installation	0%	5	5	04-May-17	09-May-17	588					
NB55 (Ch.6300-6360)-FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB02640	NB55 - Footing & Wall Structure	96.51%	24	688	07-Nov-14 A	19-May-17	393					
NB02650	NB55- backfilling	0%	50	50	20-May-17	19-Jul-17	393					
NB02660	NB55 - NB production	90.95%	40	442	15-Jan-16 A	29-May-17	696					
NB56 (Ch.6360-6400)-FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB02730	NB56 - NB production	96.32%	14	380	20-Feb-16 A	03-May-17	722					
NB02740	NB56 - NB post & panel installation	0%	5	5	04-May-17	09-May-17	588					
NB61 (Ch.6400-6560)-FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB02770	NB61 (0-50m) - Sheet piling & Excavation	0%	18	18	20-Apr-17	12-May-17	125					

Activity ID	Activity Name	Dur. % Complete	Rem. Duration	Original Duration	Start	Finish	Total Float	2017			
								Apr	May	Jun	Jul
NB02780	NB61 (0-50m) - Footing & Wall Structure	0%	50	50	13-May-17	12-Jul-17	125				
NB02790	NB61 (0-50m)- backfilling	0%	50	50	13-Jul-17	08-Sep-17	485				
NB02800	NB61 (0-50m) - NB production	0%	45	45	13-Jul-17	26-Aug-17	607				
NB02850	NB61 (50-160m) - NB production	0%	45	45	20-Apr-17	03-Jun-17	691				
NB02860	NB61 (50-160m) - NB post & panel installation	0%	5	5	05-Jun-17	09-Jun-17	562				
NB61A (Ch.6560-6745)-FH S/B Side (MTRC I&P Area)											
Noise Barrier Works											
NB02920	NB61A(0-50m) - NB production	89.05%	45	411	20-Feb-16 A	03-Jun-17	691				
NB02930	NB61A (0-50m) - NB post & panel installation	0%	5	5	05-Jun-17	09-Jun-17	562				
NB02970	NB61A ID2-3 (50-75m) - Footing & Wall Structure	90.61%	57	607	01-Apr-15 A	28-Jun-17	506				
NB02980	NB61A ID2-3 (50-75m)- backfilling	0%	20	20	29-Jun-17	22-Jul-17	521				
NB02990	NB61A ID2-3 (50-75m) - NB production	0%	45	45	29-Jun-17	12-Aug-17	621				
NB03040	NB61A (75-190m) - NB production	96.06%	15	381	20-Feb-16 A	04-May-17	721				
NB03050	NB61A (75-190m) - NB post & panel installation	0%	5	5	05-May-17	10-May-17	587				
Other Works											
Site Clearance & Demolition of Existing Structure											
Contract Condition											
MCLT1090	New MCLT - finishes works	77.5%	72	320	20-May-16 A	17-Jul-17	531				
MCLT1100	New MCLT completion	0%	0	0		17-Jul-17*	531				17-Jul-17* ◆
TCSS Works											
G54											
TCSS1500	Slow lane footing - G54 (NB61)	0%	0	0		12-Jul-17	505				12-Jul-17 ◆ Slow
South Buffer Zone 1 (SBZ1) (within Zone 2)(Ch.6740 to 6930)											
Noise Barrier Along TWSR-West and Laying New Utilities											
NB63A (Ch.6710-6840)-TWSR West Side											
Noise Barrier Works											
NB01200	NB63A-3 - NB post installation	83.45%	24	145	17-Sep-16 A	19-May-17	579				
DSD Southern Trunk Sewer, Water Main Fire Main Works											
TSZ10880	Watermain installation (along NB63A)	87.62%	13	105	02-Nov-16 A	06-May-17	157				
TSZ10890	Firemain installation (along NB63A)	48.39%	16	31	16-Feb-17 A	10-May-17	157				
NB64 & NB64A (Ch.6860-6920)-TWSR West Side											
Noise Barrier Works											
NB001060	NB64 & NB64A-NB post & panel installation	89.8%	31	304	14-Mar-16 A	27-May-17	572				
NB003060	NB64A -Footing & Wall Structure - 1 bays	0%	35	35	02-May-17	13-Jun-17	559				
Bridge Construction											
Kau Lung Hang Vehicular Bridge											
KLH Bridge - West Ramp											
KLH.1290	West Ramp - Planting	0%	21	21	20-Apr-17	16-May-17	582				
KLH Bridge - Deck 1											
KLH.3430	Deck 1 - Planting	0%	21	21	20-Apr-17	16-May-17	582				
KLH Bridge - Deck 3											
KLH.3500	Deck 3 - Planting	0%	21	21	20-Apr-17	16-May-17	614				
KLH Bridge - East Ramp											
KLH.3590	East Ramp - Planting	0%	34	34	20-Apr-17	01-Jun-17	922				
KLH Bridge - Ramp R1											
Z2.KLH.3610	Ramp R1 - Steel roof	80%	11	55	19-Jan-17 A	04-May-17	592				
KLH Bridge - Ramp R2											
Z2.KLH.1523	VO 028 - Boundary Wall to Hse 190B structure	0%	24	24	20-Apr-17*	19-May-17	553				
Z2.KLH.1524	VO 028 - Boundary Wall to Hse 190B E&M, Drainage	0%	26	26	20-May-17	20-Jun-17	553				
Z2.KLH.1550	Ramp R2 - Steel roof	33.33%	16	24	14-Mar-17 A	10-May-17	587				
Bridge Road Work											
Z2.KLH.2030	Diversion of existing pedestrian to proposed Kiu Lung Hang Vehicular	0%	1	1	22-Apr-17*	22-Apr-17	-60				
Z2.KLH.2040	Landscape work of KLHVB	0%	120	120	20-Apr-17	11-Sep-17	483				
Lift at TWSR-W Side											
L01040	Temp work & Pile cap	0%	45	45	20-Apr-17	14-Jun-17	363				
L01050	Lift pit	0%	24	24	15-Jun-17	13-Jul-17	363				
L01060	Lift shaft & roof	0%	52	52	14-Jul-17	12-Sep-17	363				
L01094	Lift submission & ordering period	61.54%	130	338	01-Aug-16 A	22-Sep-17	384				
L01140	CLP Power available (by CLP)	85.78%	63	443	04-Apr-16 A	21-Jun-17	653				
Lift at FLHY S/B											
L01200	Temp work & Pier cap	51.11%	22	45	10-Mar-17 A	17-May-17	371				
L01210	Lift pit	0%	30	30	18-May-17	22-Jun-17	371				
L01220	Lift shaft & roof	0%	90	90	23-Jun-17	09-Oct-17	371				
L01300	CLP Power available (by CLP)	80.17%	94	474	04-Apr-16 A	22-Jul-17	628				
Demolition of Existing Nam Wa Po Footbridge											
Demolition Work											
Z2.NWP.1060	Temporary support installation at existing Fanling Highway	93.33%	2	30	12-Apr-17 A	22-Apr-17	-60				
Z2.NWP.1070	Removal of existing NWP Footbridge	0%	6	6	24-Apr-17	29-Apr-17	-60				
Z2.NWP.1090	Existing Nam Wa Po Footbridge removed	0%	0	0		29-Apr-17	-60				29-Apr-17 ◆ Existing Nam Wa Po Footbridge removed
Z2.NWP.1160	Temp lighting installation	80%	3	15	18-Apr-17 A	22-Apr-17	-60				
TWSR-West Construction											
Drainage & Road Works											
General											
RDZ20130	Z2: S3: Connection of realigned TWSR-W at interface Zone 2 & 3	0%	60	60	02-May-17	13-Jul-17	45				
Noise Barrier Along Fanling Highway S/B											

Activity ID	Activity Name	Dur. % Complete	Rem. Duration	Original Duration	Start	Finish	Total Float	2017				
								Apr	May	Jun	Jul	
NB62 (Ch.6745-6910)-FH S/B Side (MTRC I&P Area)												
Noise Barrier Works												
NB03090	NB62 (0-80m) - Footing & Wall Structure	88.61%	9	79	12-Dec-16 A	29-Apr-17	554					
NB03100	NB62 (0-80m) - backfilling	0%	20	20	27-Mar-17 A	15-May-17	578					
NB03110	NB62 (0-80m) - NB production	0%	45	45	29-Apr-17	13-Jun-17	681					
NB03120	NB62 (0-80m) - NB post & panel installation	0%	5	5	13-Jun-17	19-Jun-17	554					
NB03130	NB62 (80-110m) Under bridge - Sheet piling & Excavation	0%	12	12	20-Apr-17*	05-May-17	473					
NB03140	NB62 (80-110m) Under bridge - Footing & Wall Structure	0%	25	25	06-May-17	05-Jun-17	526					
NB03150	NB62 (80-110m) Under bridge - backfilling	0%	14	14	06-Jun-17	21-Jun-17	547					
NB03160	NB62 (80-110m) Under bridge - NB production	0%	45	45	06-Jun-17	20-Jul-17	644					
NB03180	NB62 (110-170m) - Sheet piling & Excavation	0%	18	18	06-May-17	26-May-17	473					
NB03190	NB62 (110-170m) - Footing & Wall Structure	0%	60	60	27-May-17	07-Aug-17	473					
NB70 (Ch.6910-6930)-FH S/B Side												
Noise Barrier Works												
NB03290	NB70- NB post & panel installation	0%	5	5	20-Apr-17	25-Apr-17	598					
North Buffer Zone 2 (NBZ2) (within Zone 4) (Ch. 7925 to 8100)												
Bridge Construction												
New Ho Ka Yuen Footbridge												
TWSR-West/ FL Highway N/B Side Section												
HKY1273	Erect Staircase (HKY-TWSR-W side)	0%	30	30	20-Apr-17	26-May-17	605					
HKY1440	Remaining Finishes works of HKYFB	45.03%	83	151	21-Nov-16 A	29-Jul-17	507					
TWSR-East FL Highway S/B Side Section												
HKY1870	Steel Ramp finishes work (HKYFB-TWSR-E side)	77.1%	30	131	13-Oct-16 A	26-May-17	605					
Other Works												
Slope Works												
TWSR-East FL Highway S/B Side Section												
S1000	Slope S51-Fill ~3m	0%	40	40	20-Apr-17 A	08-Jun-17	559					
ZONE 4 (Ch. 7925 to 8700)												
Noise Barrier Along Fanling Highway N/B												
NB75 (Ch.7930-8090)-FH N/B Side												
Noise Barrier Works												
NB4060	NB75 - Footing & Wall Structure (Ch7930-7990)	21.67%	47	60	20-Mar-17 A	16-Jun-17	4					
NB4070	NB75 - backfilling (Ch7930-7990)	0%	20	20	17-Jun-17	11-Jul-17	4					
NB4080	NB75 - NB production (Ch7930-7990)	0%	45	45	17-Jun-17	31-Jul-17	168					
NB4120	NB75 - Footing & Wall Structure (Ch7990-8000) & G34	0%	30	30	20-Apr-17	26-May-17	29					
NB4130	NB75 - backfilling (Ch7990-8000)-(HKY-P1)	0%	12	12	27-May-17	10-Jun-17	29					
NB4140	NB75 - NB production (Ch7990-8000)-(HKY-P1)	0%	45	45	27-May-17	10-Jul-17	195					
NB4180	NB75 - Footing & Wall Structure (Ch8000-8050)	0%	50	50	20-Apr-17	20-Jun-17	2					
NB4190	NB75 - backfilling (Ch8000-8050)	0%	20	20	12-Jul-17	03-Aug-17	15					
NB4200	NB75 - NB production (Ch8000-8050)	0%	45	45	21-Jun-17	04-Aug-17	170					
NB4240	NB75 - Footing & Wall Structure (Ch8050-8090)	0%	50	50	21-Jun-17	18-Aug-17	2					
NB77 (Ch.8090-8450)-FH N/B Side												
Noise Barrier Works												
NB4300	NB77 - piling (NB77/01-08, 0.19m -34no)	33.33%	12	18	28-Feb-17 A	05-May-17	9					
NB4310	NB77 - Footing & Wall Structure (Ch8090-8190)	0%	90	90	06-May-17	21-Aug-17	9					
NB4360	NB77 - piling (NB77/09-17, 0.19m -36no)	33.33%	12	18	20-Mar-17 A	05-May-17	61					
NB4370	NB77 - Footing & Wall Structure (Ch8190-8290)	0%	90	90	06-May-17	21-Aug-17	61					
NB4420	NB77 - piling (NB77/18-25, 0.19m -34no)	23.08%	20	26	08-Apr-17 A	15-May-17	71					
NB4470	NB77 -Pre-drilling (Ch8390-8450)& G35	0%	20	20	20-Apr-17	15-May-17	86					
NB4480	NB77 - piling (NB77/26-29, 0.19m -28no)	0%	14	14	16-May-17	01-Jun-17	86					
NB4485	NB77 - piling (NB77/30, 0.19m -14no) & G35 (8nos)	0%	17	17	02-Jun-17	21-Jun-17	86					
Bridge Construction												
New Wo Hop Shek Pedstrian & Cycle Bridge												
General												
WHS1140	Existing Wo Hop Shek Bridge Demolished	0%	0	0		15-May-17	539					
TWSR-West/ FL Highway N/B Side Section												
WHS1380	WHSAB2, P8, P9 - pile cap & abutment wall	0%	90	90	20-Apr-17	07-Aug-17	303					
Demolition of Existing Wo Hop Shek Pedstrian & Cycle Bridge												
TWSR-East FL Highway S/B Side Section												
WHS1840	Demolish existing WHS Footbridge abutment wall at W77A	0%	20	20	20-Apr-17	15-May-17	539					
Slip Road Y Construction												
Underground Utility Works												
DN600 and DN900 Watermain												
DN1070	DN600 watermain laying (Ch8400 - 8600) (W77A to	0%	110	110	17-May-17	23-Sep-17	-23					
VO - Wall 76A Construction												
Retaining Wall W76A												
TWSR-East FL Highway S/B Side Section												
W76A1050	Drainage work for Caltex access road	0%	150	150	20-Apr-17	18-Oct-17	335					
Fanling Highway Construction												
Drainage & Road Works												
TWSR-East FL Highway S/B Side Section												
RDZ41086	Construct FH S/B Lane 1 & 2 (Ch7925-8000)(SA346) (after HKY	0%	145	145	20-Apr-17	12-Oct-17	147					
RDZ41114	Construct FH N/B Lane 3 (Ch7925-8600)	0%	65	65	14-Jul-17	27-Sep-17	2					
Other Works												
Retaining Wall W77A												
TWSR-East FL Highway S/B Side Section												

Activity ID	Activity Name	Dur. % Complete	Rem. Duration	Original Duration	Start	Finish	Total Float	2017			
								Apr	May	Jun	Jul
RWZ4.1080	Base slab & Wall (3-7m high)- RW77A (Ch.0-20)	34.29%	23	35	01-Apr-17 A	18-May-17	60				
RWZ4.1090	Backfilling (3-7m high) - RW77A (Ch.0-20)	0%	50	50	27-May-17	26-Jul-17	28				
RWZ4.1150	Backfilling (0-3m) - RW77A (Ch.92-120)	28.57%	30	42	01-Feb-17 A	26-May-17	28				
RWZ4.1170	Base slab & Wall (0-3m high)- RW77A last 1 bay at CH120	0%	21	21	20-Apr-17	16-May-17	-23				
RWZ4.1180	DN600 pipe installation ready to start	0%	0	0	17-May-17		-23				
Retaining Wall W77B											
TWSR-East FL Highway S/B Side Section											
RWZ4.1100	Base slab & Wall (0-3m high)- RW77B (Ch 0-23)	73.68%	15	57	20-Jan-17 A	09-May-17	28				
RWZ4.1110	Backfilling (0-3m) - RW77B (Ch 0-23)	0%	30	30	10-May-17	14-Jun-17	28				
RWZ4.1130	Backfilling (3-4m high) - RW77B (Ch.23-75)	0%	35	35	15-Jun-17	26-Jul-17	28				
Retaining Wall W78											
TWSR-East FL Highway S/B Side Section											
RWZ4.0900	Site Clearance	0%	30	30	20-Apr-17	26-May-17	78				
Slope Works											
TWSR-East FL Highway S/B Side Section											
S1030	Slope S53-Fill ~2m	0%	40	40	16-May-17	03-Jul-17	539				
TCSS Works											
TCSS Pre-Construction Works											
TCSS0120	Prepare Shop Drawing-TCSS	0%	45	45	20-Apr-17	14-Jun-17	111				
TCSS0130	Shop Drawing Comment & Approval	0%	21	21	15-Jun-17	05-Jul-17	133				
TCSS0140	Revised & Re-submission TCSS shop Drawing	0%	18	18	06-Jul-17	26-Jul-17	111				
G34											
TCSS1520	Slow lane footing - G34 (NB75)	0%	0	0		11-Jul-17	296				11-Jul-17 ◆ Slow
G35											
TCSS1550	Slip road island footing - G35 (CH8410, N/B)	0%	30	30	20-Apr-17	26-May-17	363				
DS50											
TCSS1600	Slip road island footing - DS50 (CH7940, S/B)	0%	30	30	20-Apr-17	26-May-17	423				
FVMS2 (Deleted by RFI-138, Pending for VO)											
TCSS1640	Slow lane footing - FVMS2 (CH8400, S/B)- Deleted by RFI-138	0%	30	30	20-Apr-17	26-May-17	483				

CHIU HING CONSTRUCTION AND TRANSPORTATION CO. LTD.

Contract No. 02/HY/2015

Works Order Nos: CB128519-0 & CB128520-5

Programme of Construction of Noise Barrier and Pedestrian Covered Walkway at Tai Wo Service Road East near Ho Ka Yuen


Actual Progress as on 23/4/2017 3 months Rolling Program

Rev : 01

29/3/2017

- Programmed Duration
- Actual Progress
- Critical Path Activities
- Early Start & Early Finish

Float = 3 weeks

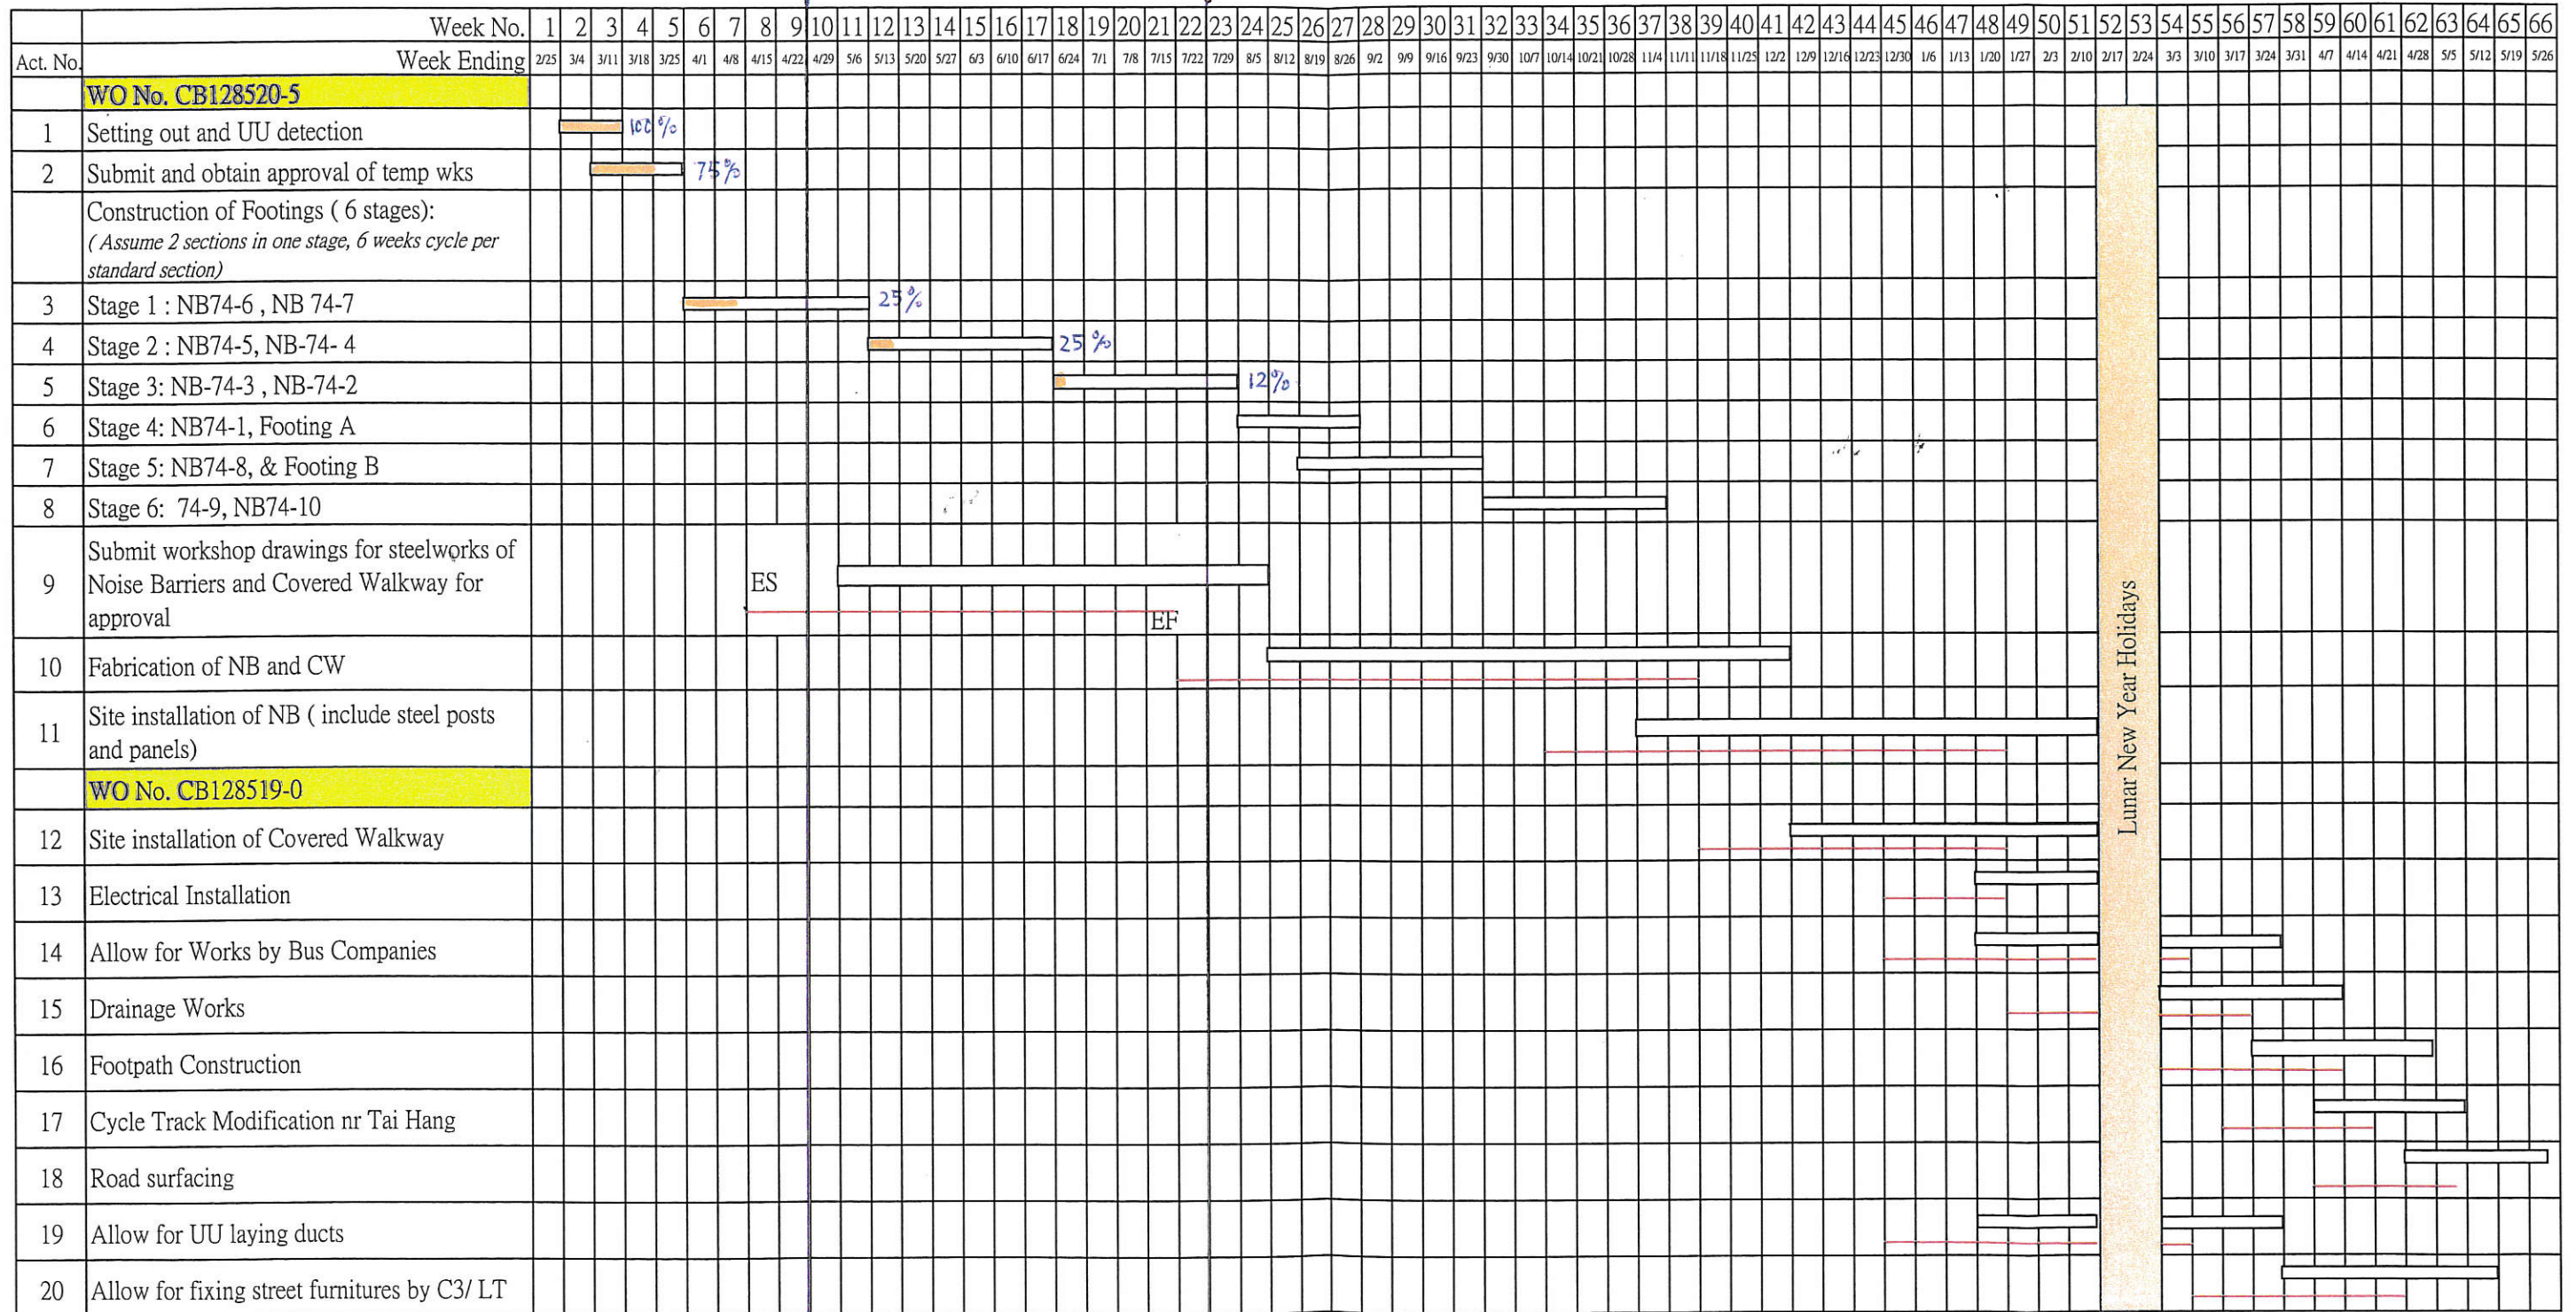

Lunar New Year Holidays

**APPENDIX C
IMPLEMENTATION SCHEDULE OF
ENVIRONMENTAL MITIGATION MEASURES
(EMIS)**

Appendix C - Implementation Schedule of Environmental Mitigation Measures (EMIS)

Air Quality – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Implementation Status	
			HY/2012/06	02/HY/2015
Air Quality during construction	Restricting heights from which materials are dropped, as far as practicable to minimize the fugitive dust arising from unloading/loading.	During construction	V	V
	All stockpiles of excavated materials or spoil of more than 50m ³ shall be enclosed, covered or dampened during dry or windy conditions.		@	V
	Effective water sprays shall be used to control potential dust emission sources such as unpaved haul roads and active construction areas.		@	V
	All spraying of materials and surfaces shall avoid excessive water usage.		V	V
	Vehicles that have the potential to create dust while transporting materials shall be covered, with the cover properly secured and extended over the edges of the side and tail boards.		V	V
	Materials shall be dampened, if necessary, before transportation.		V	V
	Travelling speeds shall be controlled to reduce traffic induced dust dispersion and re-suspension within the site from the operating haul trucks.		V	V
	Vehicle washing facilities shall be provided to minimize the quantity of material deposited on public roads.		V	V

Noise – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Implementation Status	
			HY/2012/06	02/HY2015
Noise during construction	Use of silenced plant or plant equipped with mufflers or dampers in substitute of ordinary plant.	During construction	V	V
	Reduce the number of equipment and their percentage on-time.		V	V
	3.5 m and 5.5 m high temporary noise barrier at culvert construction work area (Figure 2a of the Environmental Permit).		V	N.A.
	3 m high temporary noise barrier along the northern edge of Bridge 12 at ground level (Figure 2b of the Environmental Permit).		V	N.A.
	2 m high temporary noise barrier along the northern edge of Bridge 12 at bridge level (Figure 2b of the Environmental Permit).		V	N.A.
	2.5 m high temporary noise barrier along Tai Wo Service Road West (Figure 2c of the Environmental Permit).		V	N.A.
	3.5m and 7m high temporary noise barrier along Tai Wo Services Road West near Tai Hang (Figure 2c of the Environmental Permit).		V	N.A.
	7 m high temporary noise barrier along Tai Wo Service Road West near Tai Wo Footbridge work area (Figure 2d of the Environmental Permit).		V	N.A.
	7 m high temporary noise barrier near Kiu Tau Footbridge work area (Figure 2d of the Environmental Permit).		V	N.A.
	2.5 m high temporary noise barrier near river diversion work area (Figure 2e of the Environmental Permit).		N.A.	N.A.

Water Quality – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Implementation Status	
			HY/2012/06	02/HY/2015
Water quality during construction	Demolition and reconstruction of bridges <ul style="list-style-type: none"> - Prevent off-site migration through use of sheet piles. - Minimise duration of works as far as practical. - All sewer and drainage connections should be sealed to prevent debris, soil, sand, etc, from entering public sewers/drains. - Site surface runoff should be settled to remove sand/silt before it is discharged into the existing storm drains. 	During construction	V	N.A.
	Road Widening Works, Earthworks and Culvert Extension Works <ul style="list-style-type: none"> - Wastewater generated from any concrete batching washdown of equipment or similar activities should be discharged into foul sewers, after the removal of settleable solids, and pH adjustment as necessary. All sewage discharges from the study area should meet the TM standards and approval from EPD through the licensing process is required. - Sand traps, oil interceptors and other pollution prevention installations should be provided, properly cleaned and maintained. - Runoff from exposed working areas, unfinished slopes and from unlined temporary channels should be directed to stilling basins and/or silt traps before discharging to the drainage outfalls. - Regular inspections of stilling basins and/or silt traps are required to ensure that sediment is not conveyed into the existing drainage system. - Open stockpiles should be covered with a tarpaulin cover. - During the wet season, any exposed top soils should be covered with a tarpaulin, shotcreted or hydroseeded. - Sand and silt from wash-water from vehicle washing should be settled out before discharging into storm drains. - Fuels should be stored in bunded areas such that spillage can be easily collected. 		@	V

Waste – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Implementation Status	
			HY/2012/06	02/HY/2015
Waste management during construction	General Waste <ul style="list-style-type: none"> - Transport of wastes off site as soon as possible. - Maintenance of accurate waste records. - Minimisation of waste generation for disposal (via reduction/recycling/re-use). - No on-site burning will be permitted. - Use of re-useable metal hoardings/signboards. 	During construction	@	V
	Vegetation from site clearance <ul style="list-style-type: none"> - Segregation of materials to facilitate disposal. - Mulching to reduce bulk and where possible review opportunities for the possible beneficial use within landscaping areas. 		V	V
	Demolition Wastes <ul style="list-style-type: none"> - Segregation of materials to facilitate disposal. - Appropriate stockpile management. 		V	V
	Excavated Materials <ul style="list-style-type: none"> - Segregation of materials to facilitate disposal / reuse. - Appropriate stockpile management. - Re-use of excavated material on or off site (where possible). - Special handling and disposal procedures in the event that contaminated materials are excavated. 		V	V
	Construction Wastes <ul style="list-style-type: none"> - Segregation of materials to facilitate recycling/reuse (within designated area in appropriate containers/stockpiles). - Appropriate stockpile management. - Planning to reduce over ordering and waste generation. - Recycling and re-use of materials where possible (e.g. metal, wood from formwork) - For material which cannot be re-used/recycled, collection should be carried out by an approved waste contractor for landfill disposal. 		V	V
	Bentonite Slurries <ul style="list-style-type: none"> - Bentonite slurries should be reused as far as possible. - Disposal in accordance with Practice Note For Professional Persons ProPECC PN 1/94. 		#	N.A.

	<p>Chemical Wastes</p> <ul style="list-style-type: none"> - Storage within locked, covered and bunded area. - The storage area shall not be located adjacent to sensitive receivers e.g. drains. - Minimise waste production and recycle oils/solvents where possible. - A spill response procedure shall be in place and absorption material available for minor spillages. - Use appropriate and labelled containers. - Educate site workers on site cleanliness/waste management procedures. - If chemical wastes are to be generated, the contractor must register with EPD as a chemical waste producer. - The chemical wastes shall be collected by a licensed chemical waste collector. 		@	N.A.
	<p>Municipal Wastes</p> <ul style="list-style-type: none"> - Waste shall be stored within a temporary refuse collection facility, in appropriate containers prior to collection and disposal. - Regular, daily collections are required by an approved waste collector. 		V	V

Ecology – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Implementation Status	
			HY/2012/06	02/HY/2015
Ecology during construction	<p>Accurate Delineation of Works Area</p> <ul style="list-style-type: none"> - Boundaries of proposed works areas shall be clearly identified and separated from external areas by a physical barrier to prevent encroachment of adjacent habitats. - Individual trees which fall within the works areas but which work plans do not require removal are to be retained and fenced off to maximize protection. 	During construction	V	V
	<p>Vegetation Clearance</p> <ul style="list-style-type: none"> - No fires shall be lit within the works area for the purpose of burning cleared vegetation. - The Contractor shall give consideration to mulching the cleared vegetation for recycling within the works area / adjacent land. 		V	V
	<p>Dust generation</p> <p>There are a number of measures which shall be taken as specified in the Air Pollution Control (Construction Dust) Regulation on 'Dust Control Requirements, including the following key measures to be applied during construction:</p> <ul style="list-style-type: none"> - Vehicle washing facilities to be provided at every discernible or designated vehicle exit point; - All temporary site access roads shall be sprayed with water to suppress dust as necessary; - All dusty materials should be sprayed with water immediately prior to any handling; and - All debris should be covered entirely by impervious sheeting or stored in a sheltered debris collection area. 		@	V
	<p>Surface Run-off</p> <p>In general, mitigation measures shall be in accordance with ProPECC PN1/94 on 'Construction Site Drainage'. Key measures include:</p> <ul style="list-style-type: none"> - Bund and cover stock piles to avoid run-off; - Channel any run-off through a system of oil, grease and sediment / silt traps and reuse water on site where ever practical; - All vehicle maintenance to be undertaken within a bunded area; and - Maximise vegetation retention on-site to maximise absorption (minimise transport). 		@	V

Landscape and Visual Impact – Schedule of Recommended Mitigation Measures

Impact	Mitigation Measures	Timing	Responsibility	
			HY/2012/06	02/HY/2015
Landscape & Visual during construction	Preservation of Existing Vegetation - Trees identified for retention within the project limit would be protected during the works; - The tree transplanting and planting works shall be implemented by approved Landscape Contractors.	During construction	V	V
	Temporary Works Areas - Where feasible the works areas would be screened using hoarding and existing vegetation would be retained where possible to reduce the landscape and visual impacts arising from the construction activity. The landscape of these works areas would be restored following the completion of the construction phase.		V	V
	Hoarding - A hoarding would be erected where practicable in the most visually sensitive locations to screen the temporary construction works from the local VSRs.		V	N.A.
	Top Soils - The works will result in disturbance to extensive areas of topsoil. Topsoil worthy of retention should be stockpiled for use following completion of the civil engineering works. It should either be temporarily vegetated with hydroseeded grass or turned over on a regular basis.		#	N.A.
	Protection of Important Landscape Features - Important features such as temples, Island House and kilns within the study area, although remote from the proposed works retained and adequately protected.		#	N.A.

Legend:

V = implemented;

x = not implemented;

@ = partially implemented;

+ = recommended and immediately implemented during the site inspection by the Contractor;

N/A = not applicable - No such work was undertaken or no such material was used on site;

= to be implemented.

**APPENDIX D
SUMMARY OF ACTION AND LIMIT LEVELS**

Appendix D - Summary of Action and Limit Levels

Table 1 – Action and Limit Levels for 1-hour TSP

Location	Action Level	Limit Level
AM2	317.8 µg/m ³	500 µg/m ³

Table 2 – Action and Limit Levels for 24-hour TSP

Location	Action Level	Limit Level
AM2	200.7 µg/m ³	260 µg/m ³

Table 3 – Action and Limit Levels for Construction Noise (0700-1900 hrs of normal weekdays)

Location	Action Level	Limit Level
M2	When one documented complaint, related to 0700 – 1900 hours on normal weekdays, is received from any one of the sensitive receivers	75 dB(A)
M3*		65/70 dB(A)

*Daytime noise Limit Level of 70 dB(A) applies to education institutions, while 65dB(A) applies during school examination period

**APPENDIX E
CALIBRATION CERTIFICATES OF
MONITORING EQUIPMENTS**



TISCH ENVIRONMENTAL, INC.
 145 SOUTH MIAMI AVE
 VILLAGE OF CLEVELAND, OH
 45002
 513.467.9000
 877.263.7610 TOLL FREE
 513.467.9009 FAX

ORIFICE TRANSFER STANDARD CERTIFICATION WORKSHEET TE-5025A

Date - May 31, 2016 Rootmeter S/N 0438320 Ta (K) - 298
 Operator Tisch Orifice I.D. - 0988 Pa (mm) - 754.38

PLATE OR Run #	VOLUME START (m3)	VOLUME STOP (m3)	DIFF VOLUME (m3)	DIFF TIME (min)	METER	ORFICE
					DIFF Hg (mm)	DIFF H2O (in.)
1	NA	NA	1.00	1.3670	3.2	2.00
2	NA	NA	1.00	0.9750	6.4	4.00
3	NA	NA	1.00	0.8700	7.9	5.00
4	NA	NA	1.00	0.8260	8.7	5.50
5	NA	NA	1.00	0.6830	12.7	8.00

DATA TABULATION

Vstd	(x axis) Qstd	(y axis)	Va	(x axis) Qa	(y axis)
0.9884	0.7230	1.4090	0.9957	0.7284	0.8888
0.9842	1.0094	1.9926	0.9915	1.0170	1.2570
0.9821	1.1289	2.2278	0.9894	1.1373	1.4054
0.9811	1.1878	2.3365	0.9884	1.1967	1.4740
0.9758	1.4288	2.8179	0.9831	1.4394	1.7777
Qstd slope (m) = 1.99349			Qa slope (m) = 1.24829		
intercept (b) = -0.02737			intercept (b) = -0.01727		
coefficient (r) = 0.99988			coefficient (r) = 0.99988		
y axis = SQRT[H2O(Pa/760)(298/Ta)]			y axis = SQRT[H2O(Ta/Pa)]		

CALCULATIONS

Vstd = Diff. Vol [(Pa-Diff. Hg)/760] (298/Ta)
 Qstd = Vstd/Time

Va = Diff Vol [(Pa-Diff Hg)/Pa]
 Qa = Va/Time

For subsequent flow rate calculations:

Qstd = 1/m { [SQRT (H2O (Pa/760) (298/Ta))] - b }
 Qa = 1/m { [SQRT H2O (Ta/Pa)] - b }

EQUIPMENT CALIBRATION RECORD

Type: Laser Dust Monitor
 Manufacturer/Brand: SIBATA
 Model No.: LD-3
 Equipment No.: A.005.07a
 Sensitivity Adjustment Scale Setting: 557 CPM
 Operator: Mike Shek (MSKM)

Standard Equipment

Equipment: Rupprecht & Patashnick TEOM®
 Venue: Cyberport (Pui Ying Secondary School)
 Model No.: Series 1400AB
 Serial No: Control: 140AB219899803
 Sensor: 1200C143659803 K₀: 12500
 Last Calibration Date*: 7 May 2016

*Remarks: Recommended interval for hardware calibration is 1 year

Calibration Result

Sensitivity Adjustment Scale Setting (Before Calibration): 557 CPM
 Sensitivity Adjustment Scale Setting (After Calibration): 557 CPM

Hour	Date (dd-mm-yy)	Time	Ambient Condition		Concentration ¹ (mg/m ³) Y-axis	Total Count ²	Count/ Minute ³ X-axis
			Temp (°C)	R.H. (%)			
1	07-05-16	12:15 - 13:15	28.1	77	0.04530	1812	30.20
2	07-05-16	13:15 - 14:15	28.2	76	0.04659	1863	31.05
3	07-05-16	14:15 - 15:15	28.4	78	0.04560	1824	30.40
4	07-05-16	15:15 - 16:15	28.5	77	0.04434	1774	29.57

Note: 1. Monitoring data was measured by Rupprecht & Patashnick TEOM®
 2. Total Count was logged by Laser Dust Monitor
 3. Count/minute was calculated by (Total Count/60)

By Linear Regression of Y or X

Slope (K-factor): 0.0015
 Correlation coefficient: 0.9969

Validity of Calibration Record: 7 May 2017

Remarks:

QC Reviewer: YW Fung Signature:  Date: 09 May 2016

EQUIPMENT CALIBRATION RECORD

Type: Laser Dust Monitor
 Manufacturer/Brand: SIBATA
 Model No.: LD-3
 Equipment No.: A.005.09a
 Sensitivity Adjustment Scale Setting: 797 CPM

Operator: Mike Shek (MSKM)

Standard Equipment

Equipment: Rupprecht & Patashnick TEOM®
 Venue: Cyberport (Pui Ying Secondary School)
 Model No.: Series 1400AB
 Serial No: Control: 140AB219899803
 Sensor: 1200C143659803 Ko: 12500
 Last Calibration Date*: 7 May 2016

*Remarks: Recommended interval for hardware calibration is 1 year

Calibration Result

Sensitivity Adjustment Scale Setting (Before Calibration): 797 CPM
 Sensitivity Adjustment Scale Setting (After Calibration): 797 CPM

Hour	Date (dd-mm-yy)	Time	Ambient Condition		Concentration ¹ (mg/m ³) Y-axis	Total Count ²	Count/ Minute ³ X-axis
			Temp (°C)	R.H. (%)			
1	07-05-16	11:45 - 12:45	28.2	77	0.04623	1847	30.78
2	07-05-16	12:45 - 13:45	28.2	78	0.04708	1885	31.42
3	07-05-16	13:45 - 14:45	28.3	76	0.04591	1836	30.60
4	07-05-16	14:45 - 15:45	28.4	77	0.04333	1726	28.77

Note: 1. Monitoring data was measured by Rupprecht & Patashnick TEOM®
 2. Total Count was logged by Laser Dust Monitor
 3. Count/minute was calculated by (Total Count/60)

By Linear Regression of Y or X

Slope (K-factor): 0.0015
 Correlation coefficient: 0.9964

Validity of Calibration Record: 7 May 2017

Remarks:

QC Reviewer: YW Fung Signature:  Date: 09 May 2016



CERTIFICATE OF CALIBRATION

Certificate No.: 16CA0704 03-01 Page 1 of 2

Item tested

Description:	Sound Level Meter (Type 1)	,	Microphone
Manufacturer:	B & K	,	B & K
Type/Model No.:	2238	,	4188
Serial/Equipment No.:	2800927 / N.009.06	,	2791211
Adaptors used:	-	,	-

Item submitted by

Customer Name: AECOM ASIA CO., LTD.
Address of Customer: -
Request No.: -
Date of receipt: 04-Jul-2016

Date of test: 07-Jul-2016

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Multi function sound calibrator	B&K 4226	2288444	18-Jun-2017	CIGISMEC
Signal generator	DS 360	33873	18-Apr-2017	CEPREI
Signal generator	DS 360	61227	18-Apr-2017	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 60 ± 10 %
Air pressure: 1000 ± 5 hPa

Test specifications

- 1, The Sound Level Meter has been calibrated in accordance with the requirements as specified in BS 7580: Part 1: 1997 and the lab calibration procedure SMTP004-CA-152.
- 2, The electrical tests were performed using an electrical signal substituted for the microphone which was removed and replaced by an equivalent capacitance within a tolerance of $\pm 20\%$.
- 3, The acoustic calibration was performed using an B&K 4226 sound calibrator and corrections was applied for the difference between the free-field and pressure response of the Sound Level Meter.

Test results

This is to certify that the Sound Level Meter conforms to BS 7580: Part 1: 1997 for the conditions under which the test was performed.

Details of the performed measurements are presented on page 2 of this certificate.

Actual Measurement data are documented on worksheets.

Approved Signatory:

Huang Jian Min/Feng Jun Qi

Date: 09-Jul-2016

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.



CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 16CA0704 03-01 Page 2 of 2

1, Electrical Tests

The electrical tests were performed using an equivalent capacitance substituted for the microphone. The results are given in below with test status and the estimated uncertainties. The "Pass" means the result of the test is inside the tolerances stated in the test specifications. The "-" means the result of test is outside these tolerances.

Test:	Subtest:	Status:	Expanded Uncertainty (dB)	Coverage Factor
Self-generated noise	A	Pass	0.3	
	C	Pass	1.0	2.1
	Lin	Pass	2.0	2.2
Linearity range for Leq	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	Reference SPL on all other ranges	Pass	0.3	
	2 dB below upper limit of each range	Pass	0.3	
	2 dB above lower limit of each range	Pass	0.3	
Linearity range for SPL	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	Frequency weightings			
Time weightings	A	Pass	0.3	
	C	Pass	0.3	
	Lin	Pass	0.3	
Peak response	Single Burst Fast	Pass	0.3	
	Single Burst Slow	Pass	0.3	
R.M.S. accuracy	Single 100µs rectangular pulse	Pass	0.3	
	Crest factor of 3	Pass	0.3	
Time weighting I	Single burst 5 ms at 2000 Hz	Pass	0.3	
	Repeated at frequency of 100 Hz	Pass	0.3	
Time averaging	1 ms burst duty factor 1/10 ³ at 4kHz	Pass	0.3	
	1 ms burst duty factor 1/10 ⁴ at 4kHz	Pass	0.3	
Pulse range	Single burst 10 ms at 4 kHz	Pass	0.4	
Sound exposure level	Single burst 10 ms at 4 kHz	Pass	0.4	
Overload indication	SPL	Pass	0.3	
	Leq	Pass	0.4	

2, Acoustic tests

The complete sound level meter was calibrated on the reference range using a B&K 4226 acoustic calibrator with 1000Hz and SPL 94 dB. The sensitivity of the sound level meter was adjusted. The test result at 125 Hz and 8000 Hz are given in below with test status and the estimated uncertainties.

Test:	Subtest	Status	Expanded Uncertainty (dB)	Coverage Factor
Acoustic response	Weighting A at 125 Hz	Pass	0.3	
	Weighting A at 8000 Hz	Pass	0.5	

3, Response to associated sound calibrator

N/A

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

- End -

Calibrated by:

Date:

Fung Chi Yip
07-Jul-2016

Checked by:

Date:

Lam Tze Wai
09-Jul-2016

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.



CERTIFICATE OF CALIBRATION

N.009.04

Certificate No.: 17CA0407 01 Page 1 of 2

Item tested

Description:	Sound Level Meter (Type 1)	,	Microphone
Manufacturer:	B & K	,	B & K
Type/Model No.:	2238	,	4188
Serial/Equipment No.:	2285692	,	2250455
Adaptors used:	-	,	-

Item submitted by

Customer Name: AECOM ASIA CO., LTD.
Address of Customer: -
Request No.: -
Date of receipt: 07-Apr-2017

Date of test: 10-Apr-2017

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Multi function sound calibrator	B&K 4226	2288444	18-Jun-2017	CIGISMEC
Signal generator	DS 360	33873	18-Apr-2017	CEPREI
Signal generator	DS 360	61227	18-Apr-2017	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 50 ± 10 %
Air pressure: 1010 ± 5 hPa

Test specifications

- The Sound Level Meter has been calibrated in accordance with the requirements as specified in BS 7580: Part 1: 1997 and the lab calibration procedure SMTP004-CA-152.
- The electrical tests were performed using an electrical signal substituted for the microphone which was removed and replaced by an equivalent capacitance within a tolerance of ±20%.
- The acoustic calibration was performed using an B&K 4226 sound calibrator and corrections was applied for the difference between the free-field and pressure responsiveness of the Sound Level Meter.


Test results

This is to certify that the Sound Level Meter conforms to BS 7580: Part 1: 1997 for the conditions under which the test was performed.

Details of the performed measurements are presented on page 2 of this certificate.

Actual Measurement data are documented on worksheets.

Approved Signatory:


Huang Jian Min/Feng Jun Qi

Date: 11-Apr-2017

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.



CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 17CA0407 01 Page 2 of 2

1, Electrical Tests

The electrical tests were performed using an equivalent capacitance substituted for the microphone. The results are given in below with test status and the estimated uncertainties. The "Pass" means the result of the test is inside the tolerances stated in the test specifications. The "-" means the result of test is outside these tolerances.

Test:	Subtest:	Status:	Expanded Uncertainty (dB)	Coverage Factor
Self-generated noise	A	Pass	0.3	
	C	Pass	1.0	2.1
	Lin	Pass	2.0	2.2
Linearity range for Leq	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	Reference SPL on all other ranges	Pass	0.3	
	2 dB below upper limit of each range	Pass	0.3	
	2 dB above lower limit of each range	Pass	0.3	
Linearity range for SPL	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	A	Pass	0.3	
	C	Pass	0.3	
Frequency weightings	Lin	Pass	0.3	
	Time weightings	Single Burst Fast	Pass	0.3
	Single Burst Slow	Pass	0.3	
Peak response	Single 100µs rectangular pulse	Pass	0.3	
	R.M.S. accuracy	Crest factor of 3	Pass	0.3
Time weighting I	Single burst 5 ms at 2000 Hz	Pass	0.3	
	Repeated at frequency of 100 Hz	Pass	0.3	
Time averaging	1 ms burst duty factor 1/10 ³ at 4kHz	Pass	0.3	
	1 ms burst duty factor 1/10 ⁴ at 4kHz	Pass	0.3	
Pulse range	Single burst 10 ms at 4 kHz	Pass	0.4	
Sound exposure level	Single burst 10 ms at 4 kHz	Pass	0.4	
Overload indication	SPL	Pass	0.3	
	Leq	Pass	0.4	

2, Acoustic tests

The complete sound level meter was calibrated on the reference range using a B&K 4226 acoustic calibrator with 1000Hz and SPL 94 dB. The sensitivity of the sound level meter was adjusted. The test result at 125 Hz and 8000 Hz are given in below with test status and the estimated uncertainties.

Test:	Subtest	Status	Expanded Uncertainty (dB)	Coverage Factor
Acoustic response	Weighting A at 125 Hz	Pass	0.3	
	Weighting A at 8000 Hz	Pass	0.5	

3, Response to associated sound calibrator

N/A

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

- End -

Calibrated by:

Lai Sheng Jie

Date: 10-Apr-2017

Checked by:

Lam Tze Wai

Date: 11-Apr-2017

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.



CERTIFICATE OF CALIBRATION

Certificate No.: 16CA1201 01

Page: 1 of 2

Item tested

Description: Acoustical Calibrator (Class 1)
Manufacturer: Rion Co., Ltd.
Type/Model No.: NC-73
Serial/Equipment No.: 10307223 (CN.004.08)
Adaptors used: -

Item submitted by

Customer: AECOM ASIA CO. LTD.
Address of Customer: -
Request No.: -
Date of receipt: 01-Dec-2016

Date of test: 05-Dec-2016

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Lab standard microphone	B&K 4180	2412857	14-Apr-2017	SCL
Preamplifier	B&K 2673	2239857	28-Apr-2017	CEPREI
Measuring amplifier	B&K 2610	2346941	26-Apr-2017	CEPREI
Signal generator	DS 360	61227	18-Apr-2017	CEPREI
Digital multi-meter	34401A	US36087050	18-Apr-2017	CEPREI
Audio analyzer	8903B	GB41300350	19-Apr-2017	CEPREI
Universal counter	53132A	MY40003662	19-Apr-2017	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 55 ± 10 %
Air pressure: 1005 ± 5 hPa

Test specifications


- The Sound Calibrator has been calibrated in accordance with the requirements as specified in IEC 60942 1997 Annex B and the lab calibration procedure SMTP004-CA-156.
- The calibrator was tested with its axis vertical facing downwards at the specific frequency using insert voltage technique.
- The results are rounded to the nearest 0.01 dB and 0.1 Hz and have not been corrected for variations from a reference pressure of 1013.25 hectoPascals as the maker's information indicates that the instrument is insensitive to pressure changes.

Test results

This is to certify that the sound calibrator conforms to the requirements of annex B of IEC 60942: 1997 for the conditions under which the test was performed. This does not imply that the sound calibrator meets IEC 60942 under any other conditions.


Details of the performed measurements are presented on page 2 of this certificate.

Approved Signatory:


Huang Jian Min / Feng Jun Qi

Date: 08-Dec-2016

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.

**APPENDIX F
EM&A MONITORING SCHEDULES**

Contract No. HY/2012/06
Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange
Impact Monitoring and Audit Schedule for April 2017

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
						1-Apr
						1-hr TSP 24-hr TSP
2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr
			Site Audit		1-hr TSP 24-hr TSP Noise	
9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr
			1-hr TSP 24-hr TSP Noise	Site Audit		
16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr
		1-hr TSP 24-hr TSP Noise Site Audit				
23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr
	1-hr TSP 24-hr TSP Noise	Site Audit			1-hr TSP 24-hr TSP	
30-Apr						

Contract No. HY/2012/06
Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange
Tentative Impact Monitoring and Audit Schedule for May 2017

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
	1-May	2-May	3-May	4-May	5-May	6-May
		Site Audit		1-hr TSP 24-hr TSP Noise		
7-May	8-May	9-May	10-May	11-May	12-May	13-May
		Site Audit	1-hr TSP 24-hr TSP Noise			
14-May	15-May	16-May	17-May	18-May	19-May	20-May
		1-hr TSP 24-hr TSP Noise		Site Audit		
21-May	22-May	23-May	24-May	25-May	26-May	27-May
	1-hr TSP 24-hr TSP Noise	Site Audit				1-hr TSP 24-hr TSP
28-May	29-May	30-May	31-May			


The schedule is subject to change due to unforeseeable circumstances (e.g. adverse weather, etc)

**APPENDIX G
IMPACT AIR QUALITY MONITORING
RESULTS AND THEIR GRAPHICAL
PRESENTATION**

Appendix G
Impact Air Quality Monitoring Results

24-hour TSP Monitoring Results at Station AM2 (Fanling Government Secondary School)

Date	Weather Condition	Air Temp. (°C)	Atmospheric Pressure(hPa)	Flow Rate (m ³ /min.)		Av. flow (m ³ /min)	Total vol. (m ³)	Filter Weight (g)		Particulate weight(g)	Elapse Time		Sampling Time(hrs.)	Conc. (µg/m ³)	Action Level (µg/m ³)	Limit Level (µg/m ³)
				Initial	Final			Initial	Final		Initial	Final				
1-Apr-17	Rainy	18.7	1019.9	1.314	1.314	1.314	1892.2	2.7876	2.8969	0.1093	8490.03	8514.03	24.00	57.8	200.7	260
7-Apr-17	Sunny	24.5	1012.4	1.314	1.314	1.314	1892.2	2.8490	2.9196	0.0706	8514.03	8538.03	24.00	37.3	200.7	260
12-Apr-17	Fine	20.6	1013.2	1.314	1.314	1.314	1892.2	2.8634	2.9172	0.0538	8538.03	8562.03	24.00	28.4	200.7	260
18-Apr-17	Fine	26.7	1008.9	1.314	1.314	1.314	1892.2	2.8453	2.9769	0.1316	8562.03	8586.03	24.00	69.6	200.7	260
24-Apr-17	Rainy	21.5	1014.3	1.314	1.314	1.314	1892.2	2.8278	2.9354	0.1076	8586.03	8610.03	24.00	56.9	200.7	260
28-Apr-17	Cloudy	21.8	1015.2	1.314	1.314	1.314	1892.2	2.8445	2.8955	0.0510	8634.02	8658.02	24.00	27.0	200.7	260
													Average	46.2		
													Min	27.0		
													Max	69.6		

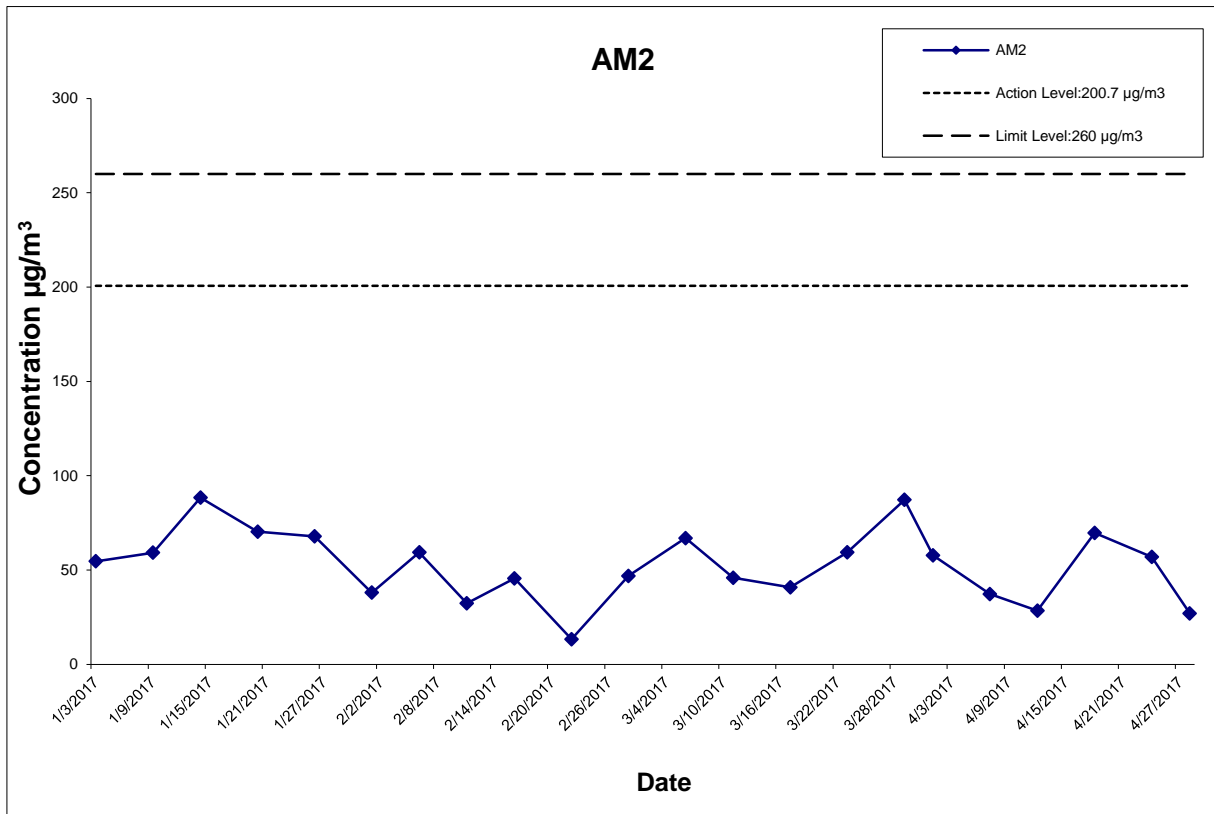

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.

CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Graphical Presentation of Impact 24-hour TSP Monitoring Results

Project No.: 60307376


Date: May-17

Appendix G

Appendix G
Impact Air Quality Monitoring Results

1-hour TSP Monitoring Results at Station AM2
(Fanling Government Secondary School)

Date	Start Time (hh:mm)	1st Hour	2nd Hour	3rd Hour
		Conc. ($\mu\text{g}/\text{m}^3$)	Conc. ($\mu\text{g}/\text{m}^3$)	Conc. ($\mu\text{g}/\text{m}^3$)
1-Apr-17	10:15	75.1	76.6	72.8
7-Apr-17	13:05	66.7	68.1	67.5
12-Apr-17	14:05	68.4	70.1	69.4
18-Apr-17	13:12	73.6	74.1	72.9
24-Apr-17	13:45	69.6	70.9	71.7
28-Apr-17	9:56	74.4	72.5	71.6
		Average	71.4	
		Min	66.7	
		Max	76.6	

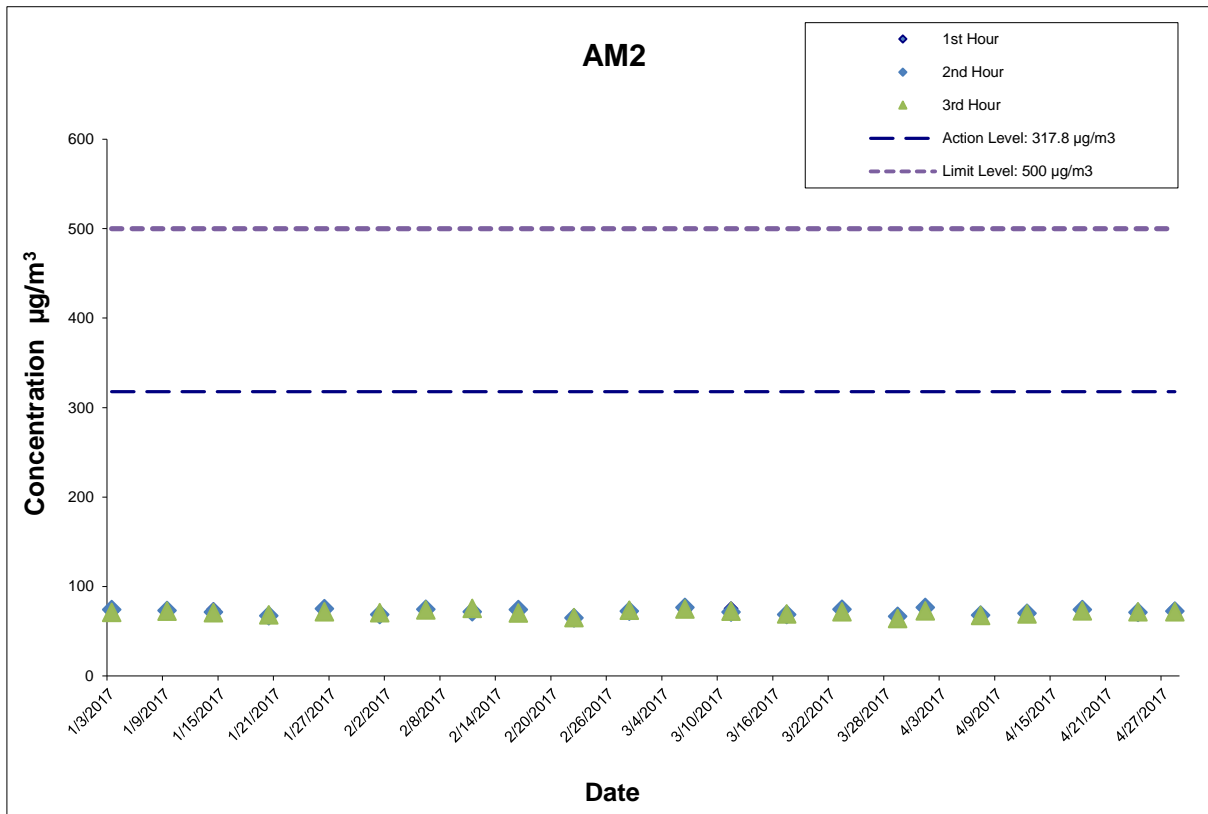

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.

CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE



Graphical Presentation of Impact 1-hour TSP Monitoring Results

Project No.: 60307376

Date: May-17

Appendix G

**APPENDIX H
METEOROLOGICAL DATA FOR THE
REPORTING MONTH**

Daily Extract of Meteorological Observations, April 2017 - Tai Po

Day	Mean Pressure (hPa)	Air Temperature			Mean Dew Point (deg. C)	Mean Relative Humidity (%)	Total Rainfall (mm)	Prevailing Wind Direction (degrees)	Mean Wind Speed (km/h)
		Absolute Daily Max (deg. C)	Mean (deg. C)	Absolute Daily Min (deg. C)					
01	1020.1	21.9	17.9	13.7	12.9	74	***	***	***
02	1021.6	22	18.7	15.2	12	68	***	***	***
03	1020.9	22.6#	19.8	16.6#	14.1	70	***	***	***
04	1018.5	23.9	20.9	18.8	17.6	81	***	***	***
05	1014.9	25.3	22.3	19.9	19.7	86	***	***	***
06	1012.5	24.1	22.7	21.8	21.5	93	***	***	***
07	1012.3	27.1#	23.9	21.6#	21.8	89	***	***	***
08	1011.9	27.0#	24	21.6#	22.1	90	***	***	***
09	1009.1	28.1	25	21.5	22.7	88	***	***	***
10	1006.2	28.1	26.6	25.7	23.8	84	***	***	***
11	1007.3	29.5	25.5	22	24.2	93	***	***	***
12	1013.4	22	18.9	17.1	17.3	91	***	***	***
13	1017.4	20.3#	18.7	17.0#	15.8	84	***	***	***
14	1015.1	23.4#	21.1	19.1#	18	83	***	***	***
15	1013.4	25.1#	22.6	20.3#	21	90	***	***	***
16	1013.1	28.1	24.6	22.8	22.5	88	***	***	***
17	1010.5	32.2	26.4	23	22.3	80	***	***	***
18	1008.4	32.4	27.2	22.8	22.1	76	***	***	***
19	1008.5	31.7#	26.6	23.2#	22.2	78	***	***	***
20	1009.3	28.3#	25	23.8#	23.9	93	***	***	***
21	1007.7	29.8	25.1	22.9	23.9	93	***	***	***
22	1013	23.3	19.4	17.4	16.4	84	***	***	***
23	1014.6	21.2	19.7	18.8	17.7	88	***	***	***
24	1014.1	21.8	20.8	19.5	18.7	87	***	***	***
25	1012.2	22.2	21.4	20.2	20.5	95	***	***	***
26	1010.6	25.2	23.1	22	22.9	98	***	***	***
27	1012.5	23.3	21.4	19.7	19.6	90	***	***	***
28	1015	23.6	20.7	18.9	16.8	78	***	***	***
29	1014.1	26	21.8	17.3	18	80	***	***	***
30	1012.9	26.4	22.6	18.7	19.2	82	***	***	***

Note:

1. Data from Hong Kong Observatory
 2. Rainfall measured in increment of 0.5 mm. Amount of < 0.5 mm cannot be detected
- *** unavailable
data incomplete

Daily Extract of Meteorological Observations, April 2017 - Tai Mei Tuk

Day	Mean Pressure (hPa)	Air Temperature			Mean Dew Point (deg. C)	Mean Relative Humidity (%)	Total Rainfall (mm)	Prevailing Wind Direction (degrees)	Mean Wind Speed (km/h)
		Absolute Daily Max (deg. C)	Mean (deg. C)	Absolute Daily Min (deg. C)					
01	***	23.0#	18.1	14.3#	***	***	0	40	16
02	***	23.5	18.8	15.4	***	***	0	50	14.5
03	***	24.2#	19.6	16.3#	***	***	0	50	17.6
04	***	24.8	21	17.8	***	***	0	70	14.9
05	***	25.5#	22.1	19.6#	***	***	0	70	11.1
06	***	25.4	22.8	21.4	***	***	0.5	60	9.3
07	***	28.3	24.1	21.5	***	***	0	60	5.9
08	***	27.4#	24.1	21.5#	***	***	0	140	5.2
09	***	28.7#	25.3	21.9#	***	***	0	240	12.2
10	***	28.0#	26.3	24.5#	***	***	0	240	16.2
11	***	27.8	25.7	22.5	***	***	2.5	240	5.3
12	***	22.6	18.9	17	***	***	32	50	9.9
13	***	20.8#	18.6	17.0#	***	***	0.5	50	6.9
14	***	24.5	21.3	18.7	***	***	0	60	6.3
15	***	27.8	23.2	20.2	***	***	0	50	7.1
16	***	29.3#	24.7	22.7#	***	***	0	60	7
17	***	31.8#	26.5	23.1#	***	***	0	140	7.9
18	***	32.2#	27.4	23.2#	***	***	0	270	9.2
19	***	31.4#	27	24.2#	***	***	0	250	10.9
20	***	28.3#	25.1	23.6#	***	***	19	50	6
21	***	29.0#	24.9#	21.6#	***	***	29.5#	040#	11.9#
22	***	21.7	18.9	16.4	***	***	10.5	30	9.5
23	***	21.5	19.7	18.5	***	***	2.5	40	7.3
24	***	21.9#	20.6	19.3#	***	***	0.5	100	10.5
25	***	22.1#	21	19.5#	***	***	14	60	11.5
26	***	26.1#	23.3	21.9#	***	***	1	60	6.3
27	***	23.4	21.4	19.9	***	***	3.5	40	13.8
28	***	25.6	21	18.9	***	***	0	40	8.4
29	***	27.3	22.2	18	***	***	0	140	4.4
30	***	27.6	23.3	19.8	***	***	0	80	5.5

Note:

1. Data from Hong Kong Observatory

2. Rainfall measured in increment of 0.5 mm. Amount of < 0.5 mm cannot be detected

*** unavailable

data incomplete

**APPENDIX I
IMPACT DAYTIME CONSTRUCTION NOISE
MONITORING RESULTS AND THEIR
GRAPHICAL PRESENTATION**

Appendix I Impact Daytime Construction Noise Monitoring Results

Location : M2 (West Tai Wo - Free Field)

Day time 07:00-19:00 hrs Normal Weekdays Impact Noise Monitoring Results

Date	Measured Noise Level for 30-min, dB(A)				Limit Level, dB(A)	Exceedance (Y/N)
	Start Time	Leq*	L10*	L90*		
7-Apr-17	13:30	67.0	69.0	65.0	75	N
12-Apr-17	14:49	70.9	72.5	68.3	75	N
18-Apr-17	13:59	69.6	70.5	66.5	75	N
24-Apr-17	14:40	69.0	71.0	66.5	75	N
	Min	67.0	69.0	65.0		
	Max	70.9	72.5	68.3		
	Average	69.3	70.9	66.7		



Location : M3 (Fanling Government Secondary School- Façade)

Day time 07:00-19:00 hrs Normal Weekdays Impact Noise Monitoring Results

Date	Measured Noise Level for 30-min, dB(A)				Limit Level, dB(A)^	Exceedance (Y/N)
	Start Time	Leq	L10	L90		
7-Apr-17	13:05	60.0	61.0	56.0	70	N
12-Apr-17	15:19	67.4	69.5	65.2	70	N
18-Apr-17	13:12	64.2	66.0	61.0	70	N
24-Apr-17	13:45	60.5	62.0	56.5	65	N
	Min	60.0	61.0	56.0		
	Max	67.4	69.5	65.2		
	Average	64.1	65.9	61.3		

* +3dB(A) Façade effect correction included

^ Limit Level of 70dB(A) applies to education institutes while 65dB(A) applies during school examination period.

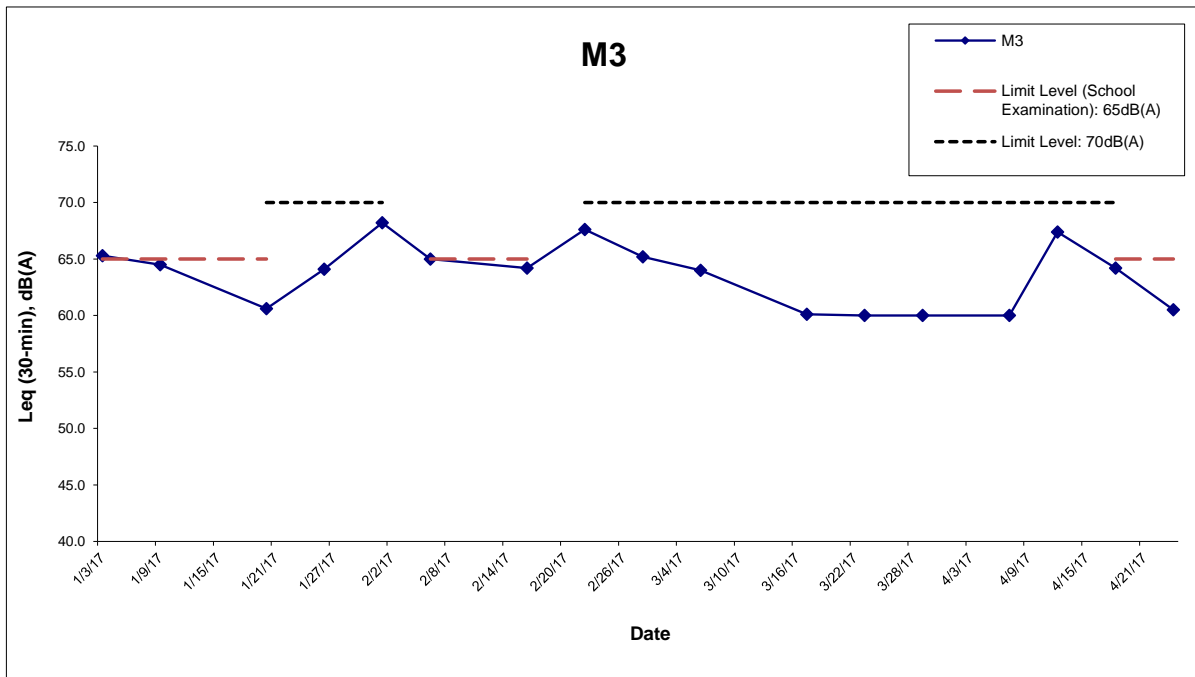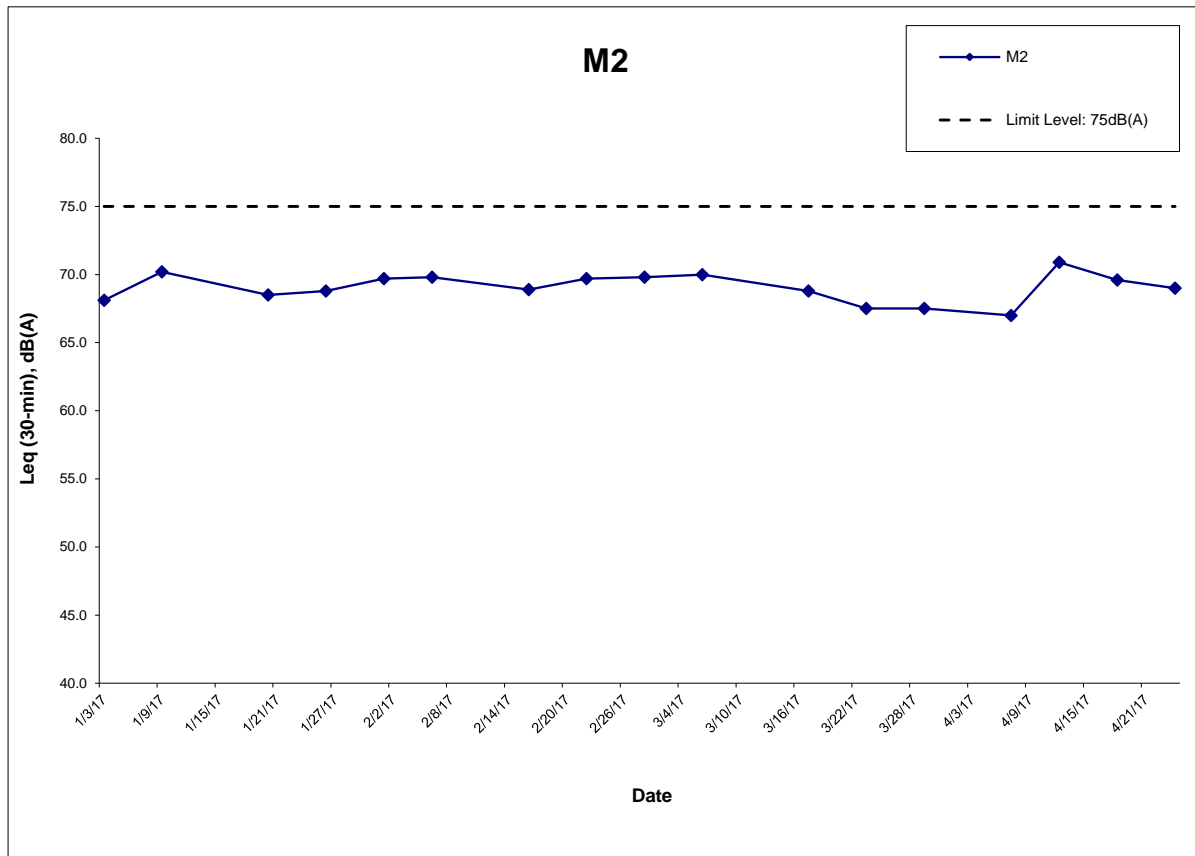

Remark:

^ Limit Level of 70dB(A) applies to education institutes while 65dB(A) applies during school examination period.

This Drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent.

CONTRACT NO. HY/2012/06
 WIDENING OF FANLING HIGHWAY
 - TAI HANG TO WO HOP SHEK INTERCHANGE

Graphical Presentation of Impact Daytime Construction Noise
 Monitoring Results

Project No.: 60307376 Date: May-17



Appendix I

**APPENDIX J
EVENT ACTION PLAN**

Appendix J – Event Action Plan

Event / Action Plan for Air Quality

Event	Action			
	ET Leader	IEC	ER	Contractor
Action Level				
Exceedance for one sample	<ol style="list-style-type: none"> 1. Identify source; 2. Inform IEC and ER; 3. Repeat measurement to confirm finding; 4. Increase monitoring frequency to daily. 	<ol style="list-style-type: none"> 1. Check monitoring data submitted by ET; 2. Check Contractor's working method. 	<ol style="list-style-type: none"> 1. Notify Contractor. 	<ol style="list-style-type: none"> 1. Rectify any unacceptable practice; 2. Amend working methods if appropriate.
Exceedance for two or more consecutive samples	<ol style="list-style-type: none"> 1. Identify source; 2. Inform IEC and ER; 3. Repeat measurements to confirm findings; 4. Increase monitoring frequency to daily; 5. Discuss with IEC and Contractor on remedial actions required; 6. If exceedance continues, arrange meeting with IEC and ER; 7. If exceedance stops, cease additional monitoring. 	<ol style="list-style-type: none"> 1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET and Contractor on possible remedial measures; 4. Advise the ER on the effectiveness of the proposed remedial measures; 5. Supervise Implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Ensure remedial measures properly implemented. 	<ol style="list-style-type: none"> 1. Submit proposals for remedial actions to IEC within 3 working days of notification; 2. Implement the agreed proposals; 3. Amend proposal if appropriate.

Event / Action Plan for Air Quality

Event Action Level	Action			
	ET Leader	IEC	ER	Contractor
Limit Level				
Exceedance for one sample	<ol style="list-style-type: none"> 1. Identify source; 2. Inform IEC, ER, Contractor and EPD; 3. Repeat measurement to confirm finding; 4. Increase monitoring frequency to daily; 5. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results. 	<ol style="list-style-type: none"> 1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET and Contractor on possible remedial measures; 4. Advise ER on the effectiveness of the proposed remedial measures; 5. Supervise implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of exceedance in writing; 2. Notify Contractor; 3. Ensure remedial measures properly implemented. 	<ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC within 3 working days of notification; 3. Implement the agreed proposals; 4. Amend proposal if appropriate.
Exceedance for two or more consecutive samples	<ol style="list-style-type: none"> 1. Notify IEC, ER, Contractor and EPD; 2. Identify source; 3. Repeat measurement to confirm findings; 4. Increase frequency to daily; 5. Analyse Contractor's working procedures to determine possible mitigation to be; 6. Arrange meeting with IEC and ER to discuss the remedial actions to be taken; 7. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; 8. If exceedance stops, cease additional monitoring. 	<ol style="list-style-type: none"> 1. Discuss amongst ER, ET, and Contractor on the potential remedial actions; 2. Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise ER accordingly; 3. Supervise the implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of exceedance in writing; 2. Notify Contractor; 3. In consultation with the IEC, agree with the Contractor on the remedial measures to be implemented; 4. Ensure remedial measures properly implemented; 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated. 	<ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC within 3 working days of notification; 3. Implement the agreed proposals; 4. Resubmit proposals if problem still not under control; 5. Stop the relevant portion of works as determined by ER until the exceedance is abated.

Event / Action Plan for Noise Impact

Event Limit Level	Action			
	ET Leader	IEC	ER	Contractor
Action Level	<ol style="list-style-type: none"> 1. Notify IEC and the Contractor. 2. Carry out investigation. 3. Report the results of investigation to IEC and the Contractor. 4. Discuss with the Contractor and formulate remedial measures. 5. Increase monitoring frequency to check mitigation effectiveness. 	<ol style="list-style-type: none"> 1. Review with analysed results submitted by ET. 2. Review the proposed remedial measures by the Contractor and advise ER accordingly. 3. Supervise the implement of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing. 2. Notify the Contractor. 3. Require the Contractor to propose remedial measures for the analysed noise problem. 4. Ensure remedial measures are properly implemented. 	<ol style="list-style-type: none"> 1. Submit noise mitigation proposals to IEC. 2. Implement noise mitigation proposals.
Limit Level	<ol style="list-style-type: none"> 1. Notify, IEC, ER, EPD and the Contractor. 2. Identify the source. 3. Repeat measurement to confirm findings. 4. Increase monitoring frequency. 5. Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented. 6. Inform IEC, ER, and EPD the causes & actions taken for the exceedances. 7. Assess effectiveness of the Contractor's remedial actions and keep IEC, EPD and ER informed of the results. 8. If exceedance stops, cease additional monitoring. 	<ol style="list-style-type: none"> 1. Discuss amongst ER, ET Leader and the Contractor on the potential remedial actions. 2. Review the Contractor's remedial actions whenever necessary to assure their effectiveness and advise ER accordingly. 3. Supervise the implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing. 2. Notify the Contractor. 3. Require the Contractor to propose remedial measures for the analysed noise problem. 4. Ensure remedial measures are properly implemented. 5. If exceedance continues, consider what activity of the work is responsible and instruct the Contractor to stop that activity of work until the exceedance is abated. 	<ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance. 2. Submit proposals for remedial actions to IEC within 3 working days of notification. 3. Implement the agreed proposals. 4. Resubmit proposals if problem still not under control. 5. Stop the relevant activity of works as determined by the ER until the exceedance is abated.

**APPENDIX K
SITE INSPECTION SUMMARIES**

Site Inspection Summary

Inspection Information

Contract No.	HY/2012/06
Date:	5 April 2017
Time:	14:00
Inspection No.:	177

Non-compliance

Nil

Observations

<p><u>Follow-up Observation(s)</u></p> <ol style="list-style-type: none"> Exposed stockpiles covered improperly at SA340 were covered entirely with impervious sheeting to prevent windblown dust emission. (Closed) Construction wastes found scattered on ground at SA340 were removed to keep the site clean and tidy. (Closed) <p><u>New Observation(s)</u></p> <ol style="list-style-type: none"> Exposed stockpiles were found at SA328. The Contractor should cover exposed stockpiles with impervious sheeting to prevent windblown dust emission. Excessive accumulation of construction wastes was observed at SA328. The Contractor should remove the wastes and maintain the site clean and tidy. Stagnant water was observed at Nam Wah Po Bridge. The Contractor should remove the stagnant water or apply larvicidal oil to prevent mosquito breeding. <p><u>Reminder (s)</u></p> <p>Nil.</p>
<p><u>Follow-up Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>New Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>Reminder (s) – 02/HY/2015</u></p> <p>Nil.</p>

Remarks

Nil

	Name	Signature	Date
Prepared by	Sammi Lam		5 April 2017
Checked by	Y W Fung	/	5 April 2017

Site Inspection Summary

Inspection Information

Contract No.	HY/2012/06
Date:	13 April 2017
Time:	14:00
Inspection No.:	178

Non-compliance

Nil

Observations

	<p><u>Follow-up Observation(s)</u></p> <ol style="list-style-type: none"> Exposed stockpiles found at SA328 were removed to prevent windblown dust emission. (Closed) Excessive accumulation of construction wastes observed at SA328 was removed. (Closed) Stagnant water observed at Nam Wah Po Bridge was cleared. (Closed) <p><u>New Observation(s)</u></p> <ol style="list-style-type: none"> Retained water was observed in the drip tray of generator at NB75. The Contractor was advised to remove the water to prevent overflow of chemical in case of spillage. A chemical container without secondary containment was found at NB75. The Contractor was advised to provide it with a drip tray to prevent potential leakage. Motor oil was found accumulated in the drip tray of welder generator at NB75. The Contractor was advised to dispose of the oil as chemical waste and ensure the equipment is well-maintained. <p><u>Reminder (s)</u></p> <p>Nil.</p>
	<p><u>Follow-up Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>New Observation(s) – 02/HY/2015</u></p> <ol style="list-style-type: none"> Stagnant water was observed on the ground. The Contractor was advised to remove the water to prevent mosquito breeding. <p><u>Reminder (s) – 02/HY/2015</u></p> <p>Nil.</p>

Remarks

Nil

	Name	Signature	Date
Prepared by	Candy Chung		13 April 2017
Checked by	Y W Fung	/	13 April 2017

Site Inspection Summary

Inspection Information

Contract No.	HY/2012/06
Date:	18 April 2017
Time:	14:00
Inspection No.:	179

Non-compliance


Nil

Observations

	<p><u>Follow-up Observation(s)</u></p> <ol style="list-style-type: none"> Retained water observed in the drip tray of generator at NB75 was removed to prevent overflow of chemical in case of spillage. (Closed) Drip tray was provided for the chemical container without secondary containment found at NB75 to prevent potential leakage. (Closed) Accumulated motor oil found in the drip tray of welder generator at NB75 was removed. (Closed) <p><u>New Observation(s)</u></p> <ol style="list-style-type: none"> Mud trail was observed at SA328. The Contractor should provide wheel washing facilities at the vehicle exit point and clean up the mud trail for dust suppression. Non-Road Mobile Machinery (NRMM) without proper label was found at SA326. The Contractor should ensure valid labels are provided for all NRMM before operations. A chemical container without secondary containment was found at SA328. The Contractor should keep chemical containers in designated storage areas, provide drip trays to prevent potential leakage. Stagnant water was observed at SA328. The Contractor should remove the standing water or apply larvicidal oil to prevent mosquito breeding. <p><u>Reminder (s)</u></p> <p>Nil.</p>
8.	<p><u>Follow-up Observation(s) – 02/HY/2015</u></p> <p>Stagnant water observed on the ground was removed. (Closed)</p> <p><u>New Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>Reminder (s) – 02/HY/2015</u></p> <p>Nil.</p>

Remarks

Nil

	Name	Signature	Date
Prepared by	Sammi Lam		18 April 2017
Checked by	Y W Fung	/	18 April 2017

Site Inspection Summary

Inspection Information

Contract No.	HY/2012/06
Date:	25 April 2017
Time:	14:00
Inspection No.:	180

Non-compliance

Nil

Observations

	<p><u>Follow-up Observation(s)</u></p> <ol style="list-style-type: none"> Mud trail observed at SA328 was cleaned up for dust suppression. (Closed) Proper Non-Road Mobile Machinery (NRMM) label was provided for NRMM found at SA326. (Closed) Drip tray was provided for chemical container without secondary containment found at SA328. (Closed) Stagnant water observed at SA328 was removed to prevent mosquito breeding. (Closed) <p><u>New Observation(s)</u></p> <ol style="list-style-type: none"> Exposed slope without cover was observed at SA310. The Contractor should cover the exposed slope properly to avoid potential windblown dust emission. Public access road at SA323 was observed dusty. The Contractor should provide sufficient measures to keep the public access road clear of dusty material. Construction wastes were found scattered on ground at SA324. The Contractor should remove the construction wastes and maintain the site clean and tidy. <p><u>Reminder (s)</u></p> <p>Nil.</p>
	<p><u>Follow-up Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>New Observation(s) – 02/HY/2015</u></p> <p>Nil.</p> <p><u>Reminder (s) – 02/HY/2015</u></p> <p>Nil.</p>

Remarks

Nil

	Name	Signature	Date
Prepared by	Sammi Lam		25 April 2017
Checked by	Y W Fung	/	25 April 2017

**APPENDIX L
STATISTICS ON COMPLAINTS,
NOTIFICATION OF SUMMONS AND
SUCCESSFUL PROSECUTIONS**

Appendix L

Statistics on Complaints, Notifications of Summons and Successful Prosecutions

Contract No. HY/2012/06 – Widening of Fanling Highway – Tai Hang to Wo Hop Shek Interchange

	Date Received	Subject	Status	Total no. followed up by the ET this month	Total no. followed up by the ET since project commencement
Environmental complaints	19 December 2013	EPD referred a complaint from Lot no. 116 of Fui Sha Wai at Tai Hang of Tai Po which is concerned about the construction noise and diesel-like smell generated from construction activities nearby which caused nuisance and health problems on 19 December 2013 morning.	Closed	0	6
	24 February 2014	EPD referred an air-and-odour complaint on 24 February 2014. The complainant complained about the construction site located near the bus stop in Fui Sha Wai, Tai Hang, Tai Wo Service Road West. When construction works were carried out, odour, white smoke and dust were generated. The complainant asked for follow-up actions.	Closed		

Date Received	Subject	Status	Total no. followed up by the ET this month	Total no. followed up by the ET since project commencement
23 October 2014	<p>EPD referred an air complaint on 24 October 2014.</p> <p>A resident complained against the excavation works of Tai Wo Service Road West between Nam Wah Po & Tai Hang Tsuen, which have piled up high stockpiles, causing serious dust nuisance to his house.</p> <p>The resident also complained that the stockpiles have not been covered and watered properly. He now requires the EPD to follow up. The location of complaint is near Lamppost Location EB5717.</p>	Closed		
31 December 2014	<p>EPD referred a water complaint on 31 December 2014.</p> <p>The complainant complained about the muddy river outside Tai Hang Village Office on 29 December 2014. It was suspected that the muddy water was discharged from the construction works of the Project. He required the EPD to follow up.</p>	Closed		
25 March 2015	<p>EPD referred a water complaint on 25 March 2015.</p> <p>The complainant complained about the generation of the smell of gasoline from the Widening of Fanling Highway construction site on Tai Wo Service Road West, causing serious nuisance to nearby houses.</p> <p>The situation has continued for a few weeks and she asked the EPD</p>	Closed		

	Date Received	Subject	Status	Total no. followed up by the ET this month	Total no. followed up by the ET since project commencement
		to follow up as soon as possible.			
	5 January 2017 (Referred by the Contractor on 13 January 2017)	<p>A complaint was received by the 1823 enquiry and complaint hotline on 5 January 2017. The complaint was referred to the Environmental Team by the Contractor on 13 January 2017.</p> <p>The complainant complained against the dust emission generated by the Widening of Fanling Highway construction site on Tai Wo Service Road West near Tai Hang Village.</p> <p>The complainant also complained that Highway Department did not conduct road surface cleansing, which affects residents' health. He/she now requires the Highway Department to follow up.</p>	Closed		
Notification of summons	-	-	-	0	0
Successful Prosecutions	-	-	-	0	0

Contract No. 02/HY/2015 – Provision of Bus-Bus Interchange on Fanling Highway Kowloon Bound

	Date Received	Subject	Status	Total no. followed up by the ET this month	Total no. followed up by the ET since project commencement
Environmental complaints	-	-	-	0	0
Notification of summons	-	-	-	0	0
Successful Prosecutions	-	-	-	0	0